


1100 TYPICAL DETAIL ANCHORAGE OF MASONRY WALL TO STEEL COL.

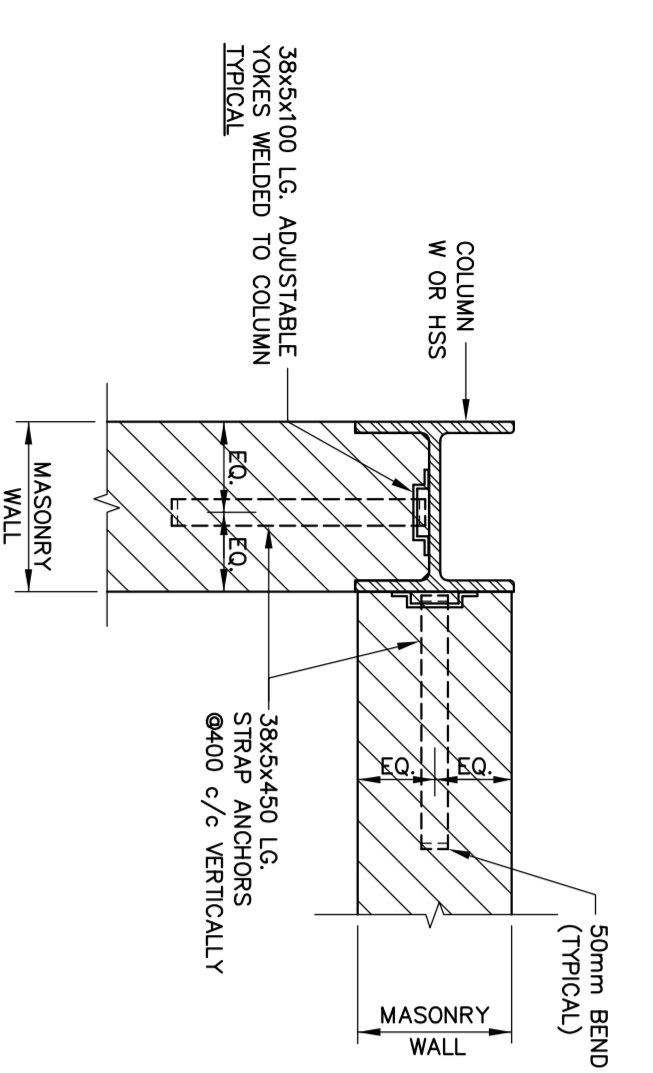


1103 TYPICAL STEEL LINTELS IN NON-LOAD BEARING MASONRY WALLS


MAX CLEAR SPAN	280	290	300	315	365
1200	2E - 90x90x8 ① L-90x90x8 (LHV) ② L-125x90x8 (LHV)	3E - 90x90x8 ① L-100x100x8 (LHV) ② L-100x100x8 (LHV) ③ L-90x90x8	3E - 90x90x8 ① L-100x100x8 (LHV) ② L-100x100x8 (LHV) ③ L-90x90x8	3E - 90x90x8 ① L-100x100x8 (LHV) ② L-100x100x8 (LHV) ③ L-90x90x8	3E - 90x90x8 ① L-100x100x8 (LHV) ② L-100x100x8 (LHV) ③ L-90x90x8
1800	2E - 100x90x8 (LHV) ① L-125x90x8 (LHV) ② L-125x125x10	3E - 100x90x8 (LHV) ① L-100x100x8 (LHV) ② L-100x100x8 (LHV) ③ L-90x90x8	3E - 100x90x8 (LHV) ① L-100x100x8 (LHV) ② L-100x100x8 (LHV) ③ L-90x90x8	3E - 100x90x8 (LHV) ① L-100x100x8 (LHV) ② L-100x100x8 (LHV) ③ L-90x90x8	3E - 100x90x8 (LHV) ① L-100x100x8 (LHV) ② L-100x100x8 (LHV) ③ L-90x90x8
2400	2E - 125x90x8 (LHV) ① L-125x90x8 (LHV) ② L-150x125x10	3E - 125x90x8 (LHV) ① L-125x90x8 (LHV) ② L-125x90x8 (LHV) ③ L-150x100x10 (LHV)	3E - 125x90x8 (LHV) ① L-125x90x8 (LHV) ② L-125x90x8 (LHV) ③ L-150x100x10 (LHV)	3E - 125x90x8 (LHV) ① L-125x90x8 (LHV) ② L-125x90x8 (LHV) ③ L-150x100x10 (LHV)	3E - 125x90x8 (LHV) ① L-125x90x8 (LHV) ② L-125x90x8 (LHV) ③ L-150x100x10 (LHV)
3000	2E - 125x100x10 (LHV) ① L-150x100x10 (LHV) ② L-150x150x10	3E - 150x100x10 (LHV) ① L-150x100x10 (LHV) ② L-150x100x10 (LHV) ③ L-150x100x10 (LHV)	3E - 150x100x10 (LHV) ① L-150x100x10 (LHV) ② L-150x100x10 (LHV) ③ L-150x100x10 (LHV)	3E - 150x100x10 (LHV) ① L-150x100x10 (LHV) ② L-150x100x10 (LHV) ③ L-150x100x10 (LHV)	3E - 150x100x10 (LHV) ① L-150x100x10 (LHV) ② L-150x100x10 (LHV) ③ L-150x100x10 (LHV)

- NOTES:
- FOR 150 WALL USE E307 250 WALL ABOVE.
 - MIN END BEARING FOR LINTELS SHALL BE 150mm.
 - BACK TO BACK ANGLES SHALL BE BOLTED OR WELDED TOGETHER WHEN CLEAR SPAN EXCEEDS 1800mm.
 - ALL ANGLES SHALL BE HOT-DIPPED GALVANIZED IF EXPOSED TO WEATHER.
 - PROVIDE L-90x90x10 WELDED TO STEEL COLUMN OR BOLTED TO CONCRETE COLUMN OR WALL.
 - STRUCTURAL STEEL SHALL CONFORM TO CAN/CSA C40.21-04, 300K.

1106 TYPICAL LATERAL SUPPORT FOR NON-LOAD BEARING WALL

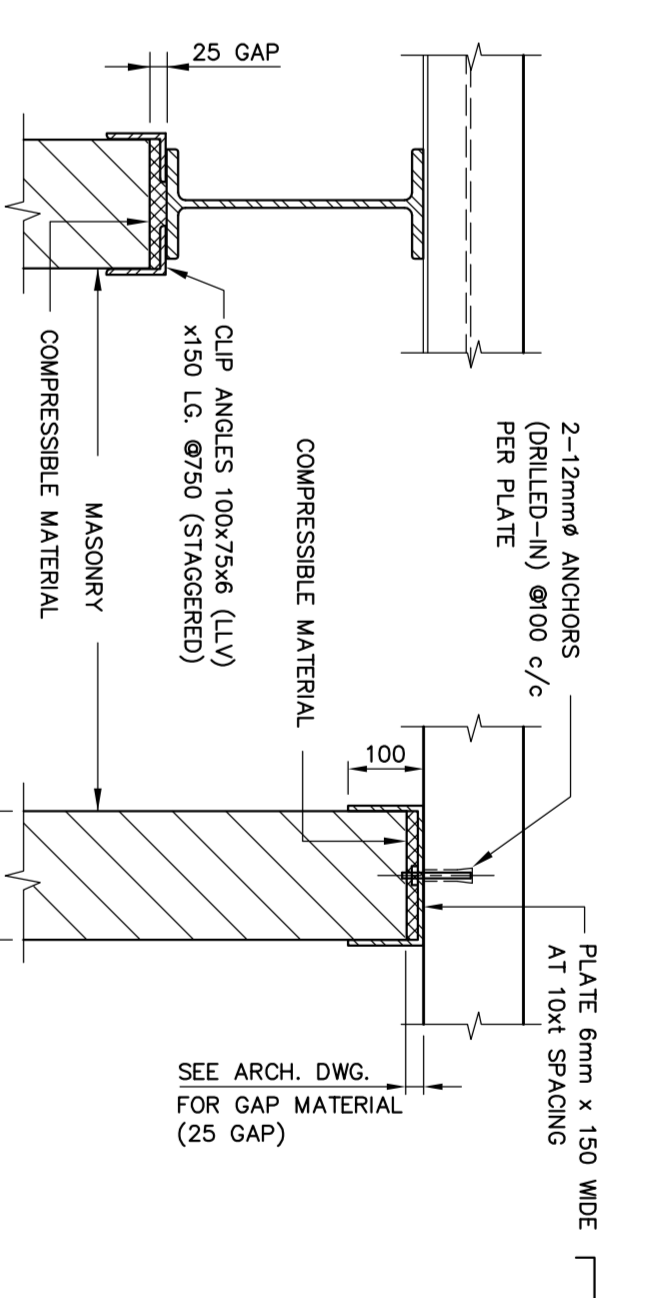

1107 TYPICAL SHELF ANGLE DETAIL

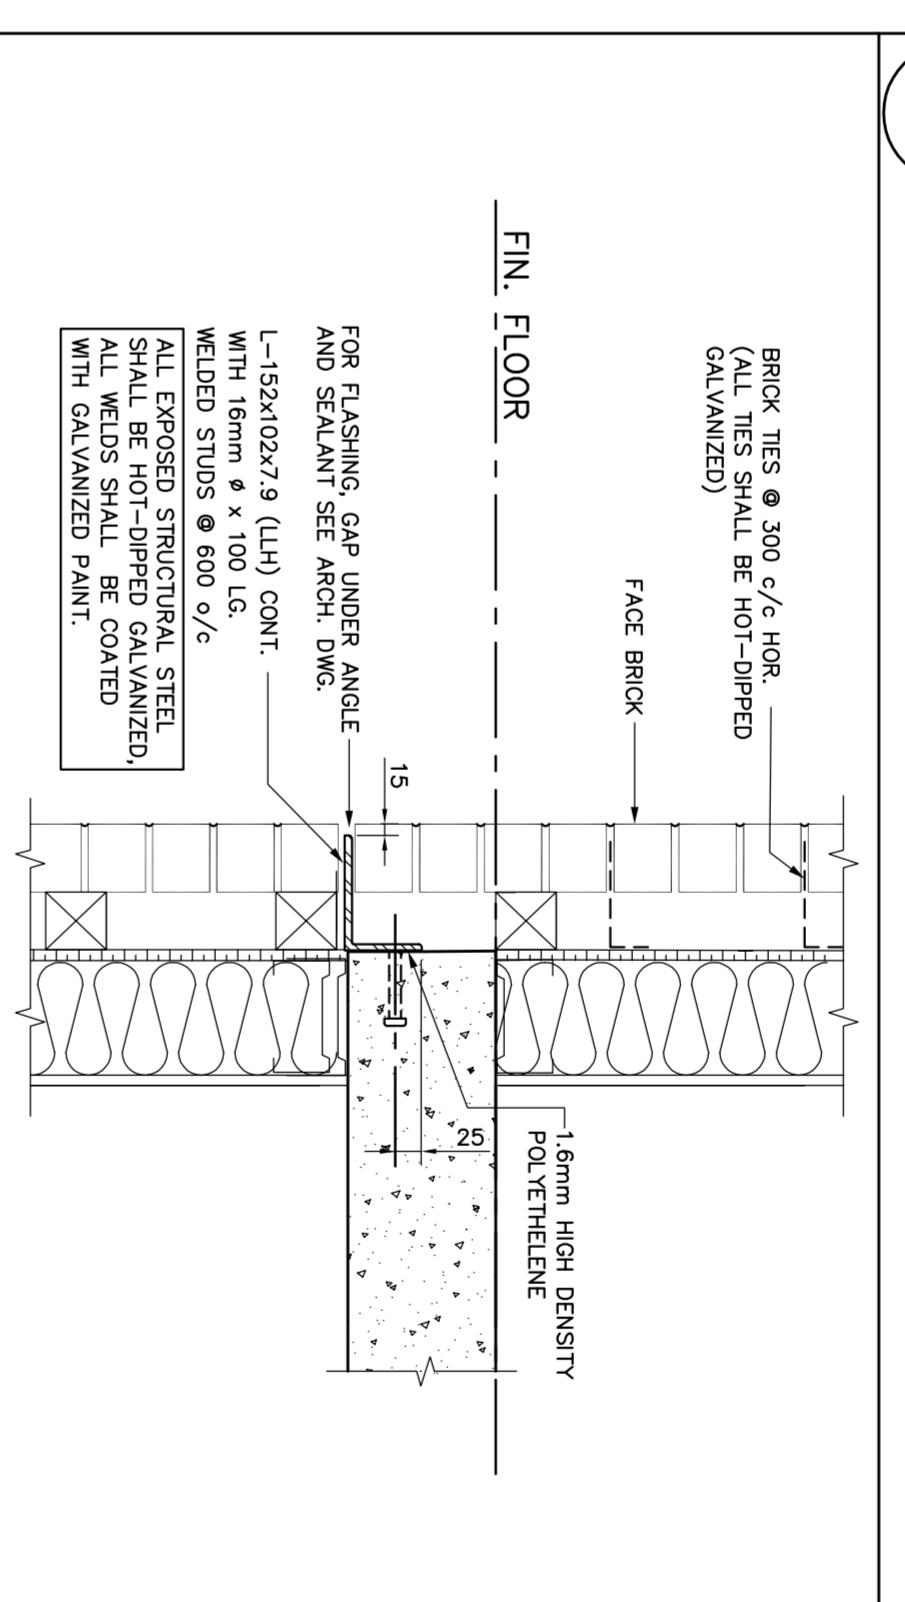

1102 LINTEL SCHEDULE

MASONRY CLEAR SPAN	BLOCK LINTEL	MASONRY CLEAR SPAN	STEEL LINTEL FOR EXTERIOR WALL
2000	FOR INTERIOR WALL 1-15 CONIT	1800	90L BRKCK L-102x102x8
2400	FOR INTERIOR WALL 2-15 CONIT	2000	90L BRKCK L-102x102x8 + L-91x51x4.8
2400	FOR EXTERIOR & CAVITY WALL 2-15 CONIT	2400	90L BRKCK L-152x102x8 (LHV) + L-91x51x4.8
2400	FOR EXTERIOR & CAVITY WALL 4-15 CONIT	2400	90L BRKCK L-152x102x10 (LHV) + L-91x51x4.8
3000	FOR EXTERIOR & CAVITY WALL 4-15 CONIT	3000	90L BRKCK L-152x102x10 (LHV) + L-91x51x4.8
3600	FOR EXTERIOR & CAVITY WALL 4-15 CONIT	3600	90L BRKCK L-203x102x13 (LHV) + L-91x51x4.8


- NOTES:
- MINIMUM END BEARING FOR LINTELS SHALL BE 200mm.
 - CONCRETE FILL SHALL BE $f_c = 28\text{MPa}$.
 - PROVIDE TEMPORARY SHORING TO SUPPORT MASONRY OVER LINTEL.
 - PROVIDE 10000 STIRRUPS 2-25 CONIT.
 - PROVIDE 10000 STIRRUPS 2-25 CONIT.

1104 STEEL LINTELS FOR NON-LOAD BEARING WALLS OF HOLLOW CONCRETE BLOCK (ANY AGGREGATE)

STEEL ANGLES CLEAR SPAN MAX	280	140	180	240	290
1200	2E - 91x58x4.8 L.L.V. ① L-91x58x4.8 (LHV)	2E - 64x64x6.4 ① L-64x64x6.4 (LHV)	2E - 89x76x6.4 L.L.V. ① L-102x76x6.4 L.L.H. ② L-127x76x6.4 L.L.H.	2E - 89x76x6.4 L.L.V. ① L-102x76x6.4 L.L.H. ② L-127x76x6.4 L.L.H.	3E - 89x76x6.4 L.L.V. ① L-102x76x6.4 L.L.H. ② L-127x76x6.4 L.L.H.
1600	2E - 91x58x4.8 L.L.V. ① L-91x58x4.8 (LHV)	2E - 64x64x6.4 ① L-64x64x6.4 (LHV)	2E - 89x76x6.4 L.L.V. ① L-102x76x6.4 L.L.H. ② L-127x76x6.4 L.L.H.	2E - 89x76x6.4 L.L.V. ① L-102x76x6.4 L.L.H. ② L-127x76x6.4 L.L.H.	3E - 89x76x6.4 L.L.V. ① L-102x76x6.4 L.L.H. ② L-127x76x6.4 L.L.H.
2000	2E - 91x58x4.8 L.L.V. ① L-91x58x4.8 (LHV)	2E - 64x64x6.4 ① L-64x64x6.4 (LHV)	2E - 89x76x6.4 L.L.V. ① L-102x76x6.4 L.L.H. ② L-127x76x6.4 L.L.H.	2E - 89x76x6.4 L.L.V. ① L-102x76x6.4 L.L.H. ② L-127x76x6.4 L.L.H.	3E - 89x76x6.4 L.L.V. ① L-102x76x6.4 L.L.H. ② L-127x76x6.4 L.L.H.
2400	2E - 91x58x4.8 L.L.V. ① L-91x58x4.8 (LHV)	2E - 64x64x6.4 ① L-64x64x6.4 (LHV)	2E - 89x76x6.4 L.L.V. ① L-102x76x6.4 L.L.H. ② L-127x76x6.4 L.L.H.	2E - 89x76x6.4 L.L.V. ① L-102x76x6.4 L.L.H. ② L-127x76x6.4 L.L.H.	3E - 89x76x6.4 L.L.V. ① L-102x76x6.4 L.L.H. ② L-127x76x6.4 L.L.H.

- NOTES:
- MINIMUM END BEARING FOR LINTELS SHALL BE 150mm.
 - MINIMUM END BEARING FOR LINTELS SHALL BE 150mm.
 - CONNECT ANGLES AT 800 mm c/c BY WELDING OR BOLTING FOR ANGLES WITH A TOTAL LENGTH OF 1800mm OR MORE.
 - PROVIDE L-90x90x10 WELDED TO STEEL COLUMN OR BOLTED TO CONCRETE COLUMN OR WALL.
 - ALL ANGLES SHALL BE HOT-DIPPED GALVANIZED IF EXPOSED TO WEATHER.

1105 DETAILS OF MASONRY BASE PLATES

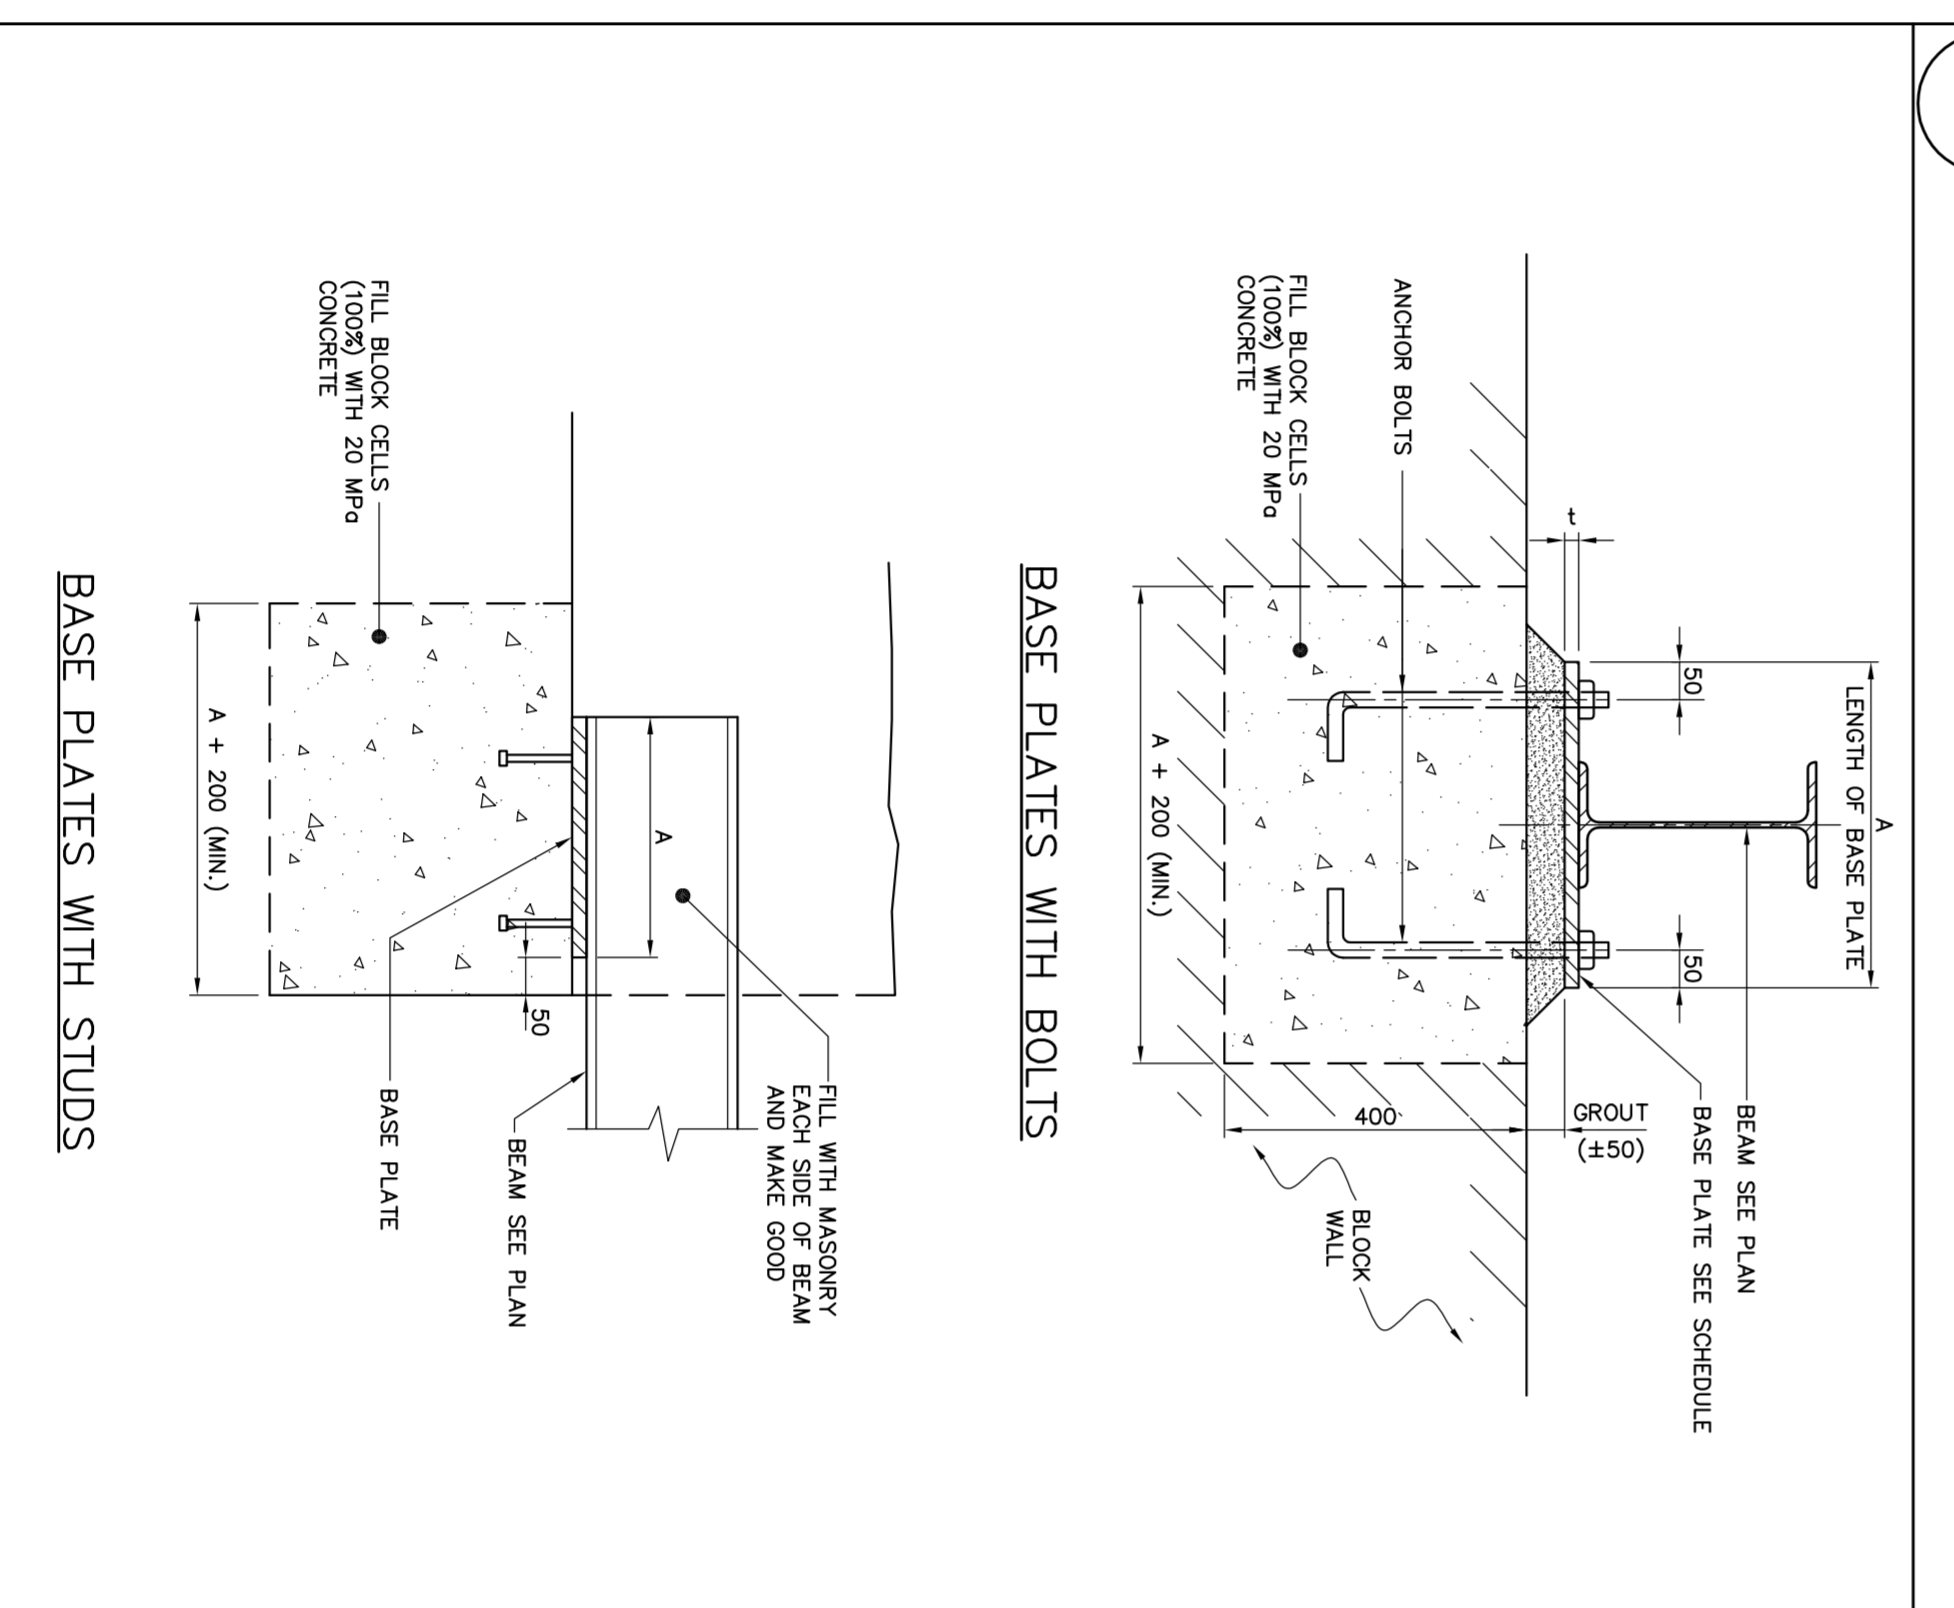


- NOTES:
- MINIMUM END BEARING FOR LINTELS SHALL BE 200mm.
 - CONCRETE FILL SHALL BE $f_c = 28\text{MPa}$.
 - PROVIDE TEMPORARY SHORING TO SUPPORT MASONRY OVER LINTEL.
 - PROVIDE 10000 STIRRUPS 2-25 CONIT.
 - PROVIDE 10000 STIRRUPS 2-25 CONIT.

Jablonsky, Asd
and Partners
ENGINEERS
 609 WILSON BLVD. SUITE 205
 TORONTO, ONTARIO M5G 1B3
 TEL: 416-464-2727
 FAX: 416-464-2727
 E-MAIL: info@jablonsky.com

FIRST FLOOR ELEV. 80.00m

NO.	ISSUED FOR	DATE
1	ISSUED FOR PERMIT	2014/03/14
2	ISSUED FOR CONSTRUCTION	2014/03/14
3	ISSUED FOR CONSTRUCTION	2014/03/14
4	ISSUED FOR CONSTRUCTION	2014/03/14
5	ISSUED FOR CONSTRUCTION	2014/03/14

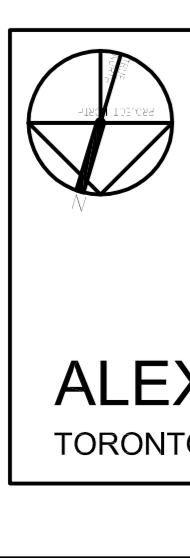

ALEXANDRA PARK - BLOCK 11
 TORONTO, ONTARIO