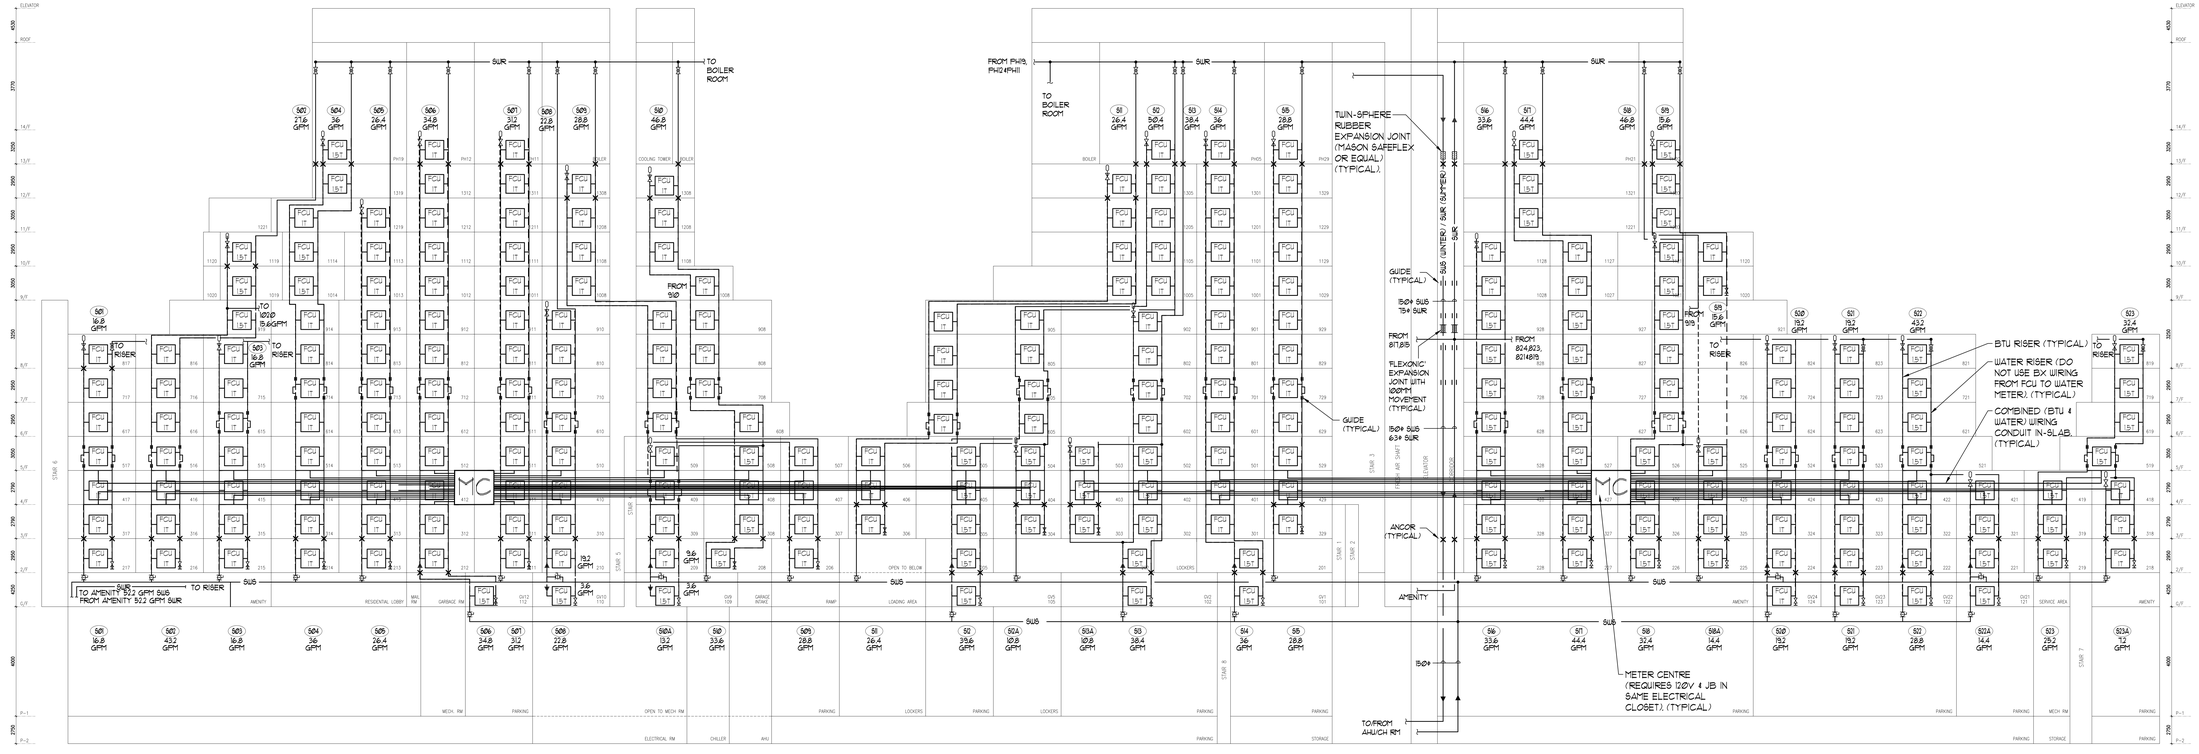

SPECIAL NOTES:

1) NO BX CABLE TO BE USED.
2) ACTUAL LOCATION OF METERING CENTRE (MC) TO BE DETERMINED BY ELECTRICIAN; LOWEST POSSIBLE FLOOR # IN A CLOSET WITHOUT A SUITE DISTRIBUTION PANEL.
3) METERING CENTRE (MC) REQUIRES 120V POWER & JUNCTION BOX.
4) 1ST JUNCTION BOX FOR SUITE DISTRIBUTION PANEL (FROM THE BOTTOM) REQUIRES 120V POWER.
5) HOME RUN FLOOR TO BE DETERMINED BY ELECTRICIAN.

ELECTRICAL LEGEND

LIGHTING

- FLUORESCENT LIGHT FIXTURE, TYPE AS INDICATED
- NIGHT LIGHT OR LIGHT CONNECTED TO EMERGENCY POWER
- CEILING MOUNTED/WALL MOUNTED LIGHT FIXTURE, INSCRIBED LETTER DENOTES TYPE
- POLE MOUNTED LIGHT FIXTURE, INSCRIBED LETTER DENOTES TYPE
- CAPPED CEILING LIGHT OUTLET
- TRACK LIGHT
- STRIP LIGHT
- UNDER CABINET FLUORESCENT LIGHT FIXTURE
- CEILING MOUNTED/WALL MOUNTED EXIT SIGN
- SINGLE/DUAL EMERGENCY LAMP REMOTE HEAD
- EMERGENCY BATTERY PACK
- OPS — OCCUPANCY SENSOR POWER PACKS
- S / S2 / S3, S4, SP, SD — SINGLE/TUO/THREE POLE, SINGLE/TUO/THREE THROW TOGGLE SWITCH RESPECTIVELY, ('S','4','P','D' DENOTES 3-WAY, 4-WAY, PILOT LIGHT, DIMMER SWITCHED LIGHT RESPECTIVELY)
- MASTER LIGHTING SHUT-OFF SWITCH
- SENSOR WALL SWITCH PIR, SELF POWERED
- OCCUPANCY SENSOR, CEILING MOUNTED

POWER

- REGULAR DUPLEX RECEPTACLE
- DUPLEX RECEPTACLE, GROUND FAULT INTERRUPT
- 5-20R 'T-SLOT DUPLEX RECEPTACLE
- SINGLE RECEPTACLE, TYPE AND CONFIGURATION AS SPECIFIED FOR DRYER
- CONNECTION FOR OVEN/COOKTOP
- ABOVE COUNTER DEVICE
- CEILING MOUNTED DEVICES
- FLOOR MOUNTED DEVICES
- DISCONNECT SWITCH, NON-FUSED
- DISCONNECT SWITCH, FUSED
- COMBINATION STARTER
- FRACTIONAL MOTOR/FAN DIRECT CONNECTION
- DIRECT CONNECTION, SINGLE PHASE
- DIRECT CONNECTION, THREE PHASE
- THERMOSTAT
- DRYER SENSOR
- HEAT TRACE
- CWH/EH — ELECTRICAL HEATER
- ELECTRICAL PANEL / SECURITY PANEL

TELECOMMUNICATION

- TV/CABLE OUTLET
- TELEPHONE OUTLET
- TELEPHONE/TV CABLE (MULTI-PORT OUTLET)
- DATA OUTLET
- DATA/TELEPHONE OUTLET
- IB — IN SUITE TELECOMM. BOX C&I RECEPTACLE
- LP — LIFT LOCATION
- MS / DC — MUSIC SPEAKER / VOLUME CONTROL
- MR — RADIO RECEIVER

SECURITY

- IC / IBC — INTERCOM / ENTERPHONE
- ICC — INTERCOM WITH CAMERA
- PBS / PSBS — PANIC BUTTON / PANIC INTERCOM STATION
- CR — CARD READER
- ARCA / ARR — AUTOMATIC RELEASE CARD ACCESS/RADIO RECEIVER
- ES — ELECTRIC STRIKE
- ML — MAGLOCK
- DC / IDC — DOOR CONTACT / WINDOW CONTACT
- GBD — GLASS BREAK DETECTOR
- AD — AUTOMATIC DOOR OPERATOR
- MD — MOTION DETECTOR
- PB — PUSH BUTTON
- SECURITY CAMERA

LIFE SAFETY

- FIRE ALARM SMOKE DETECTOR
- SMOKE ALARM
- FIRE ALARM DUCT TYPE SMOKE DETECTOR
- FIRE ALARM HEAT DETECTOR
- FIXED TEMP. 88 °C DEGREE HEAT DETECTOR
- MOISTURE PROOF HEAT DETECTOR
- CO ALARM
- COMBINATION SMOKE & CO ALARM
- CO SENSOR / NO SENSOR
- FIRE ALARM MANUAL PULL STATION
- FIREFIGHTER'S HANDSET
- FIRE ALARM SPEAKER/STROBE, WALL MTD.
- FIRE ALARM SPEAKER, WALL MTD.
- FIRE ALARM SPEAKER/STROBE CEILING MTD.
- FIRE ALARM SPEAKER, CEILING MTD.
- FAA — FIRE ALARM ANNUNCIATOR PANEL
- FACP — FIRE ALARM CONTROL PANEL

BY/DA	#	RE-ISSUED FOR TENDER	AT
DATE	NO.	DESCRIPTION	BY

MARK VOID ALL PRINTS DATED PREVIOUS TO FINAL DATE ABOVE

REVISIONS

CONTRACTOR MUST CHECK AND VERIFY ALL DIMENSIONS AND CONDITIONS ON THE JOB AND REPORT ANY DISCREPANCIES TO THE ENGINEER BEFORE PROCEEDING WITH THE WORK. THIS DRAWING IS THE PROPERTY OF THE ENGINEERS AND MUST BE RETURNED UPON COMPLETION OF THE WORK.

DRAWINGS ARE NOT TO BE SCALED

NOVA TREND ENGINEERING GROUP LTD.
139 West Beaver Creek Road, Unit 31
Richmond Hill, Ontario L4B 3M1
Tel: 905 882-8449
Fax: 905 882-8441
Email: cad@novatrendeng.com

DRAWING TITLE:
METERING NETWORK DETAILS

PROJECT TITLE:
ALEXANDRA PARK
38 CAMERON STREET, BLOCK 11
TORONTO ONTARIO

DRAWN BY:	CHECKED BY:	SCALE:
S.O.	S.T.	N.T.S.
DATE:	PROJECT NUMBER:	DRAWING NUMBER:
FEB. 13	1313	E-36 OF

Drawing name: \\CADSERVER\Current Dwgs\13\1313 - Alexandra Park\DRAWINGS\1313E- 36SYSTEM WATER RISER DIAGRAM.dwg Plotted: Oct 31, 2014 - 3:29pm