


UNIT	NAME	AREA (SQ. FT.)	* OF UR	* OF FOLDER	SIZE (T)	FIXTURE UNITS	BR	SQ. FT./T
1201	1A-MR	525	1	0	1	10	1	525
1205	3A	810	2	0	2	16	3	435
1208	3AR	810	2	0	2	16	3	435
1211	1C-D3	590	2	0	1	16	1	590
1212	1C-D3	590	2	0	1	16	1	590
1215	35T	895	2	0	2	16	2	448
1220	2B-DT	1000	2	1	15	22	2	661
1221	2L-TR	755	2	0	15	16	2	503
1225	1A-M1	580	1	0	1	10	1	580

- GENERAL NOTES:**
- CONTRACTOR SHALL CO-ORDINATE ARCHITECTURAL, STRUCTURAL, LIGHTING, HVAC, SPRINKLER DRAWINGS TO AVOID AREAS OF CONFLICT AND TO MAINTAIN CEILING HEIGHTS.
 - CONTRACTOR SHALL REPORT ALL DISCREPANCIES AND AREA OF CONFLICTS TO THE ENGINEER PRIOR TO WORK BEGINS.
 - PROVIDE EXPANSION CHAMBERS FOR ALL KITCHEN SINKS.
 - SEE INSTALLATION DETAILS DRAWING FOR WASHER DOM. H/C WATER SANITARY CONNECTION DETAILS.
 - SUPPLY AND INSTALL COMPLETE DOMESTIC HOT AND COLD WATER LINES SANITARY AND VENT LINES TO EACH FIXTURE EQUIPMENT INCLUDING WATER CLOSETS, LAVATORIES, BATHS, SHOWERS, KITCHEN SINK, WASHING MACHINES, DISHWASHERS, AND FLOOR DRAINS. KITCHEN SINK, LAVATORIES, WATER CLOSETS AND WASHING MACHINE TO BE C/W LOCALIZED SHUT-OFF VALVES.
 - ALL VENT PIPE INSTALLATION TO COMPLY WITH PLUMBING CODES.
 - FOR D.H.C. W. RISER SIZES, REFER TO RISER DIAGRAM
 - FIRE DAMPERS ARE REQUIRED TO BE LISTED AND ARE TO HAVE FIRE PROTECTION RATING OF THE PENETRATED FIRE SEPARATION.
 - THE PIPING PENETRATING THE VARIOUS FIRE SEPARATION IS REQUIRED TO BE FIRESTOPPED WITH A LISTED FIRESTOPPING MATERIAL IN ACCORDANCE WITH OBC ARTICLE 3.19.1
 - THE FIRE HOSE CABINET THAT ARE RECESSED INTO THE EXIT STAIR SHAFTS ARE REQUIRED TO BE SEPARATED FROM THE EXIT STAIR BY A 2 HR. FIRE SEPARATION.
 - NO FLEXIBLE DUCT SHALL BE USED FOR ANY IN-SUITE DUCTWORK.
 - PROVIDE 25MM EXTERNAL INSULATION TO ENTIRE FRESH AIR DUCT FROM EXTERIOR WALL TO ERY FAN COIL UNIT.
 - DRYER EXHAUST DUCT SHALL BE SMOOTH AND CORROSION-RESISTANT MATERIAL (FLEXIBLE CONNECTION IS NOT ACCEPTABLE).

LEGEND MECHANICAL

SYMBOL	DESCRIPTION
[Symbol]	SUPPLY AIR DIFFUSER
[Symbol]	SUPPLY AIR NOZZLE
[Symbol]	LINEAR SUPPLY DIFFUSER
[Symbol]	FAN MATCH
[Symbol]	RETURN AIR GRILLE
[Symbol]	EXHAUST AIR GRILLE
[Symbol]	SUPPLY DUCT UP
[Symbol]	SUPPLY DUCT DOWN
[Symbol]	RETURN DUCT UP
[Symbol]	RETURN DUCT DOWN
[Symbol]	EXHAUST DUCT UP
[Symbol]	EXHAUST DUCT DOWN
[Symbol]	FIRE DAMPER
[Symbol]	BALANCING DAMPER
[Symbol]	HORIZONTAL DAMPER
[Symbol]	HORIZONTAL FIRE DAMPER
[Symbol]	BACKDRAFT DAMPER
[Symbol]	SPRINGED BLADE VALVE CONTROL DAMPER
[Symbol]	CALL LOCKING DAMPER
[Symbol]	TUNING VANES
[Symbol]	FLEXIBLE CONNECTION
[Symbol]	ACOUSTIC INSULATION
[Symbol]	TYPE OF EQUIPMENT
[Symbol]	EQUIPMENT IDENTIFICATION
[Symbol]	TYPE OF DAMPER OR GRILLE
[Symbol]	GRILLE SIZE OR DIFFUSER RISE SIZE
[Symbol]	PIPE DIA. (HT OR LT)
[Symbol]	EXHAUST (I/F FRESH AIR INTAKE)
[Symbol]	IN-SUITE ERY MASTER SWITCH
[Symbol]	FAN MATCH / IN-SUITE ERY OVERRIDE BUTTON
[Symbol]	EQ ROOM
[Symbol]	GAS LINE
[Symbol]	GAS METER
[Symbol]	GAS DOOR
[Symbol]	PRESSURE REDUCING VALVE
[Symbol]	SANITARY ABOVE GRADE
[Symbol]	SANITARY BELOW GRADE
[Symbol]	STORM ABOVE GRADE
[Symbol]	STORM BELOW GRADE
[Symbol]	DOMESTIC COLD WATER
[Symbol]	DOMESTIC HOT WATER REGULATION
[Symbol]	SANITARY VENT
[Symbol]	WATER METER
[Symbol]	FLOOR DRAIN
[Symbol]	PLUMB FLOOR DRAIN
[Symbol]	ROOF DRAIN
[Symbol]	BLDG DRAIN
[Symbol]	AREA DRAIN
[Symbol]	B/L-LEVEL AREA DRAIN
[Symbol]	SANITARY TRAP
[Symbol]	ELBOW UP
[Symbol]	ELBOW DOWN
[Symbol]	WALL CLEANOUT
[Symbol]	FLOOR CLEANOUT
[Symbol]	HOSE BIBS
[Symbol]	NON-FREEZE HOSE BIBS
[Symbol]	DOOR VALVE
[Symbol]	SLATE VALVE
[Symbol]	BALL VALVE
[Symbol]	BUTTERFLY VALVE
[Symbol]	PRESSURE REDUCING VALVE
[Symbol]	CHECK VALVE
[Symbol]	CAP
[Symbol]	COMPRESSED AIR OUTLET
[Symbol]	BACKFLOW PREVENTER
[Symbol]	SHOULDER BALANCING VALVE
[Symbol]	TEMPERATURE SENSOR
[Symbol]	DIAPHRAGM
[Symbol]	2-WAY MODULATING VALVE
[Symbol]	3-WAY MODULATING VALVE
[Symbol]	(2-WAY) THERMOSTAT
[Symbol]	FLOOR ELEVATION ABOVE LEVEL
[Symbol]	CU 17 BUSHING 4 1/2" PLUG
[Symbol]	FLOOR ELEVATION THIS LEVEL
[Symbol]	ROOF FLOOR TO US LEVEL

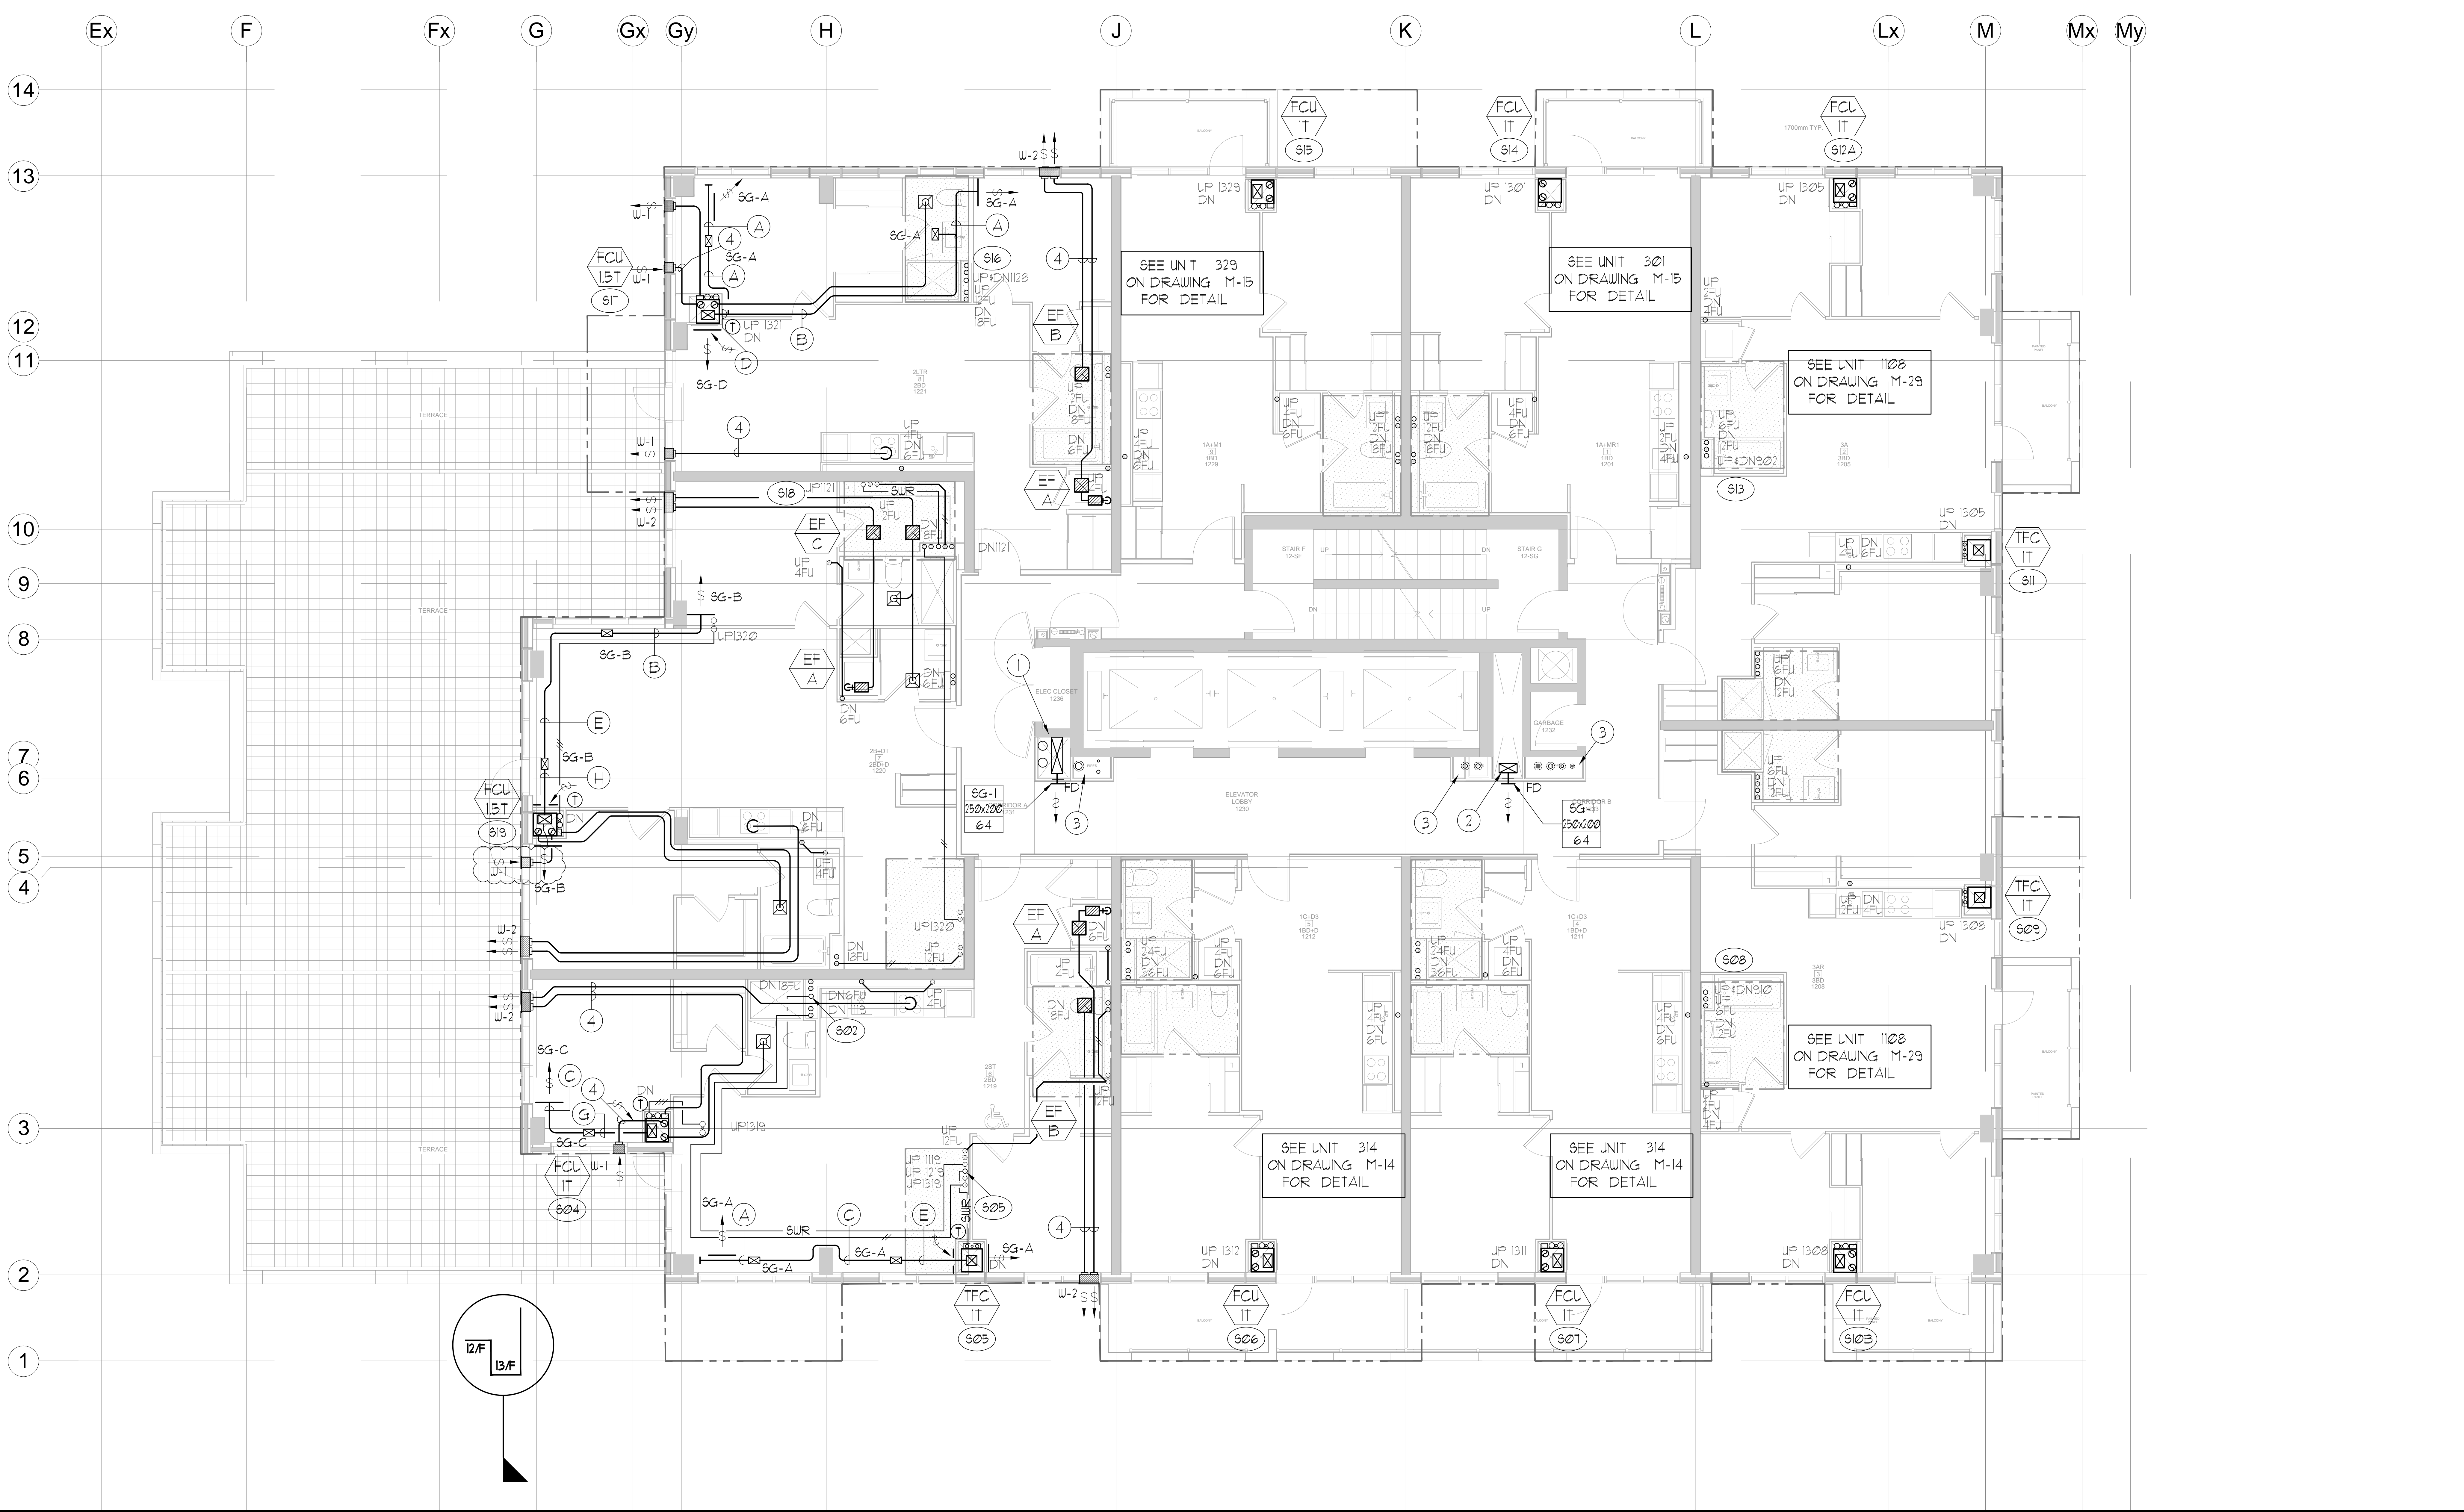

REFER TO DWG. M-X FOR ACOUSTIC NOTES

CLEAR FLOOR TO UNDERSLAB = 2150mm
 CLEAR PRODUCT = 2100mm
 UNITS 1219/1220: DRAIN FROM TERRACE ON 13/F

- NOTES:**
- SOUTH F/A SHAFT B FROM G/F TO 14/F DUCT SERVING CORRIDOR FROM 9/F TO 14/F. SEE VENTILATION RISER DIAGRAM FOR DETAILS.
 - NORTH F/A SERVING FROM G/F TO 14/F. F/A DUCT SERVING CORRIDOR FROM G/F TO 14/F. SEE VENTILATION RISER DIAGRAM FOR DETAILS.
 - PIPE SHAFT - REFER TO PIPE DIAGRAM FOR DETAILS.
 - 150# KITCHEN / DRYER / W/R / FCU INTAKE / FCU EXHAUST DUCT. (TYPICAL UNLESS OTHERWISE NOTED)

GRILLE SIZING TABLE

DESIGNATION	SIZE	L/S (UNLESS SPECIFIED ELSEWHERE)
SG-A	300x100	41-70
SG-B	300x150	71-93
SG-C	400x150	94-140
SG-D	450x150	141-188
EG-A	150x150	35
W-1	225x200	210mm(L)
W-2	425x200	INSULATED
W-3	625x200	WALL BOX

VERTICAL FAN COIL SIZE

DESIGNATION	MODEL	W x D
FCU-1T	450	500x660
FCU-15T	600	500x660
FCU-2T	800	500x660
FCU-25T	1000	550x660
FCU-3T	1200	550x660

NOTE: A MIN. OF 125mm IS REQUIRED ON THE SIDE OF PIPE RISER.

DUCT SIZING TABLE (4.06 m/s, 800 FPM)

DESIGNATION	L/s	DUCT SIZE	DESIGNATION	L/s	DUCT SIZE
A	47	100x150	G	189	350x150
B	71	150x150	H	236	450x150
C	94	200x150	J	283	500x150
D	118	200x150	K	330	600x150
E	141	250x150	L	377	500x200
F	165	300x150			

REVISIONS

NO.	DATE	BY	DESCRIPTION

NOVA CONSULTANTS INC. PROFESSIONAL ENGINEERING
 175 West Beaver Creek Road, Unit 31, Richmond Hill, Ontario L4B 3M1
 Tel: 905-883-5445 Fax: 905-882-5441 Email: cad@novastand.com

PROJECT TITLE: ALEXANDRA PARK
 DRAWING TITLE: 12/F MECHANICAL LAYOUT
 SCALE: 1:50
 DATE: FEB, 13 2013
 DRAWING NUMBER: M-30 OF 33