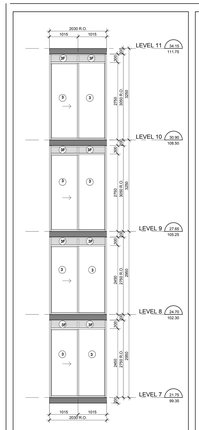

Interior East Elevation - Part 5 (20 / A4-18)
Scale: 1 : 50

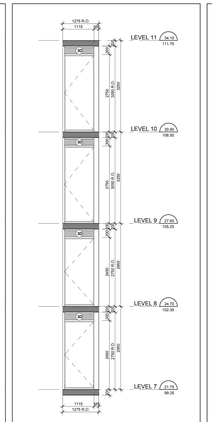

Interior East Elevation - Part 4 (19 / A4-18)
Scale: 1 : 50

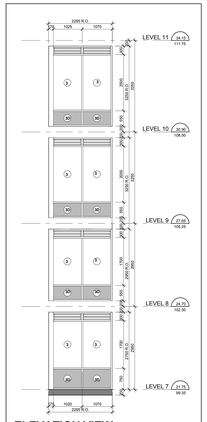

ELEVATION VIEW



FLOOR PLAN VIEW

Interior East Elevation - Part 3 (18 / A4-18)
Scale: 1 : 50

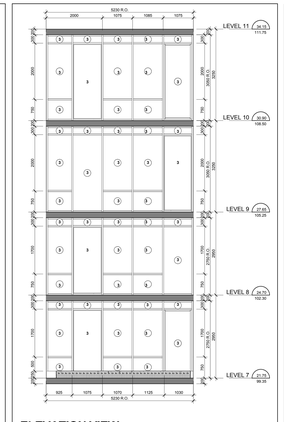

ELEVATION VIEW



FLOOR PLAN VIEW

Interior East Elevation - Part 2 (17 / A4-18)
Scale: 1 : 50

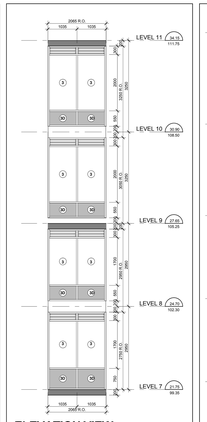

ELEVATION VIEW



FLOOR PLAN VIEW

Interior East Elevation - Part 1 (16 / A4-18)
Scale: 1 : 50

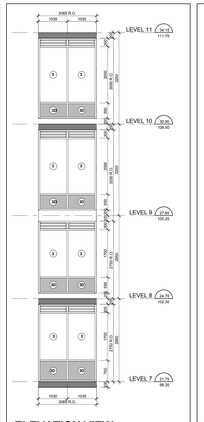

ELEVATION VIEW



FLOOR PLAN VIEW

Interior West Elevation - Part 22 (15 / A4-18)
Scale: 1 : 50

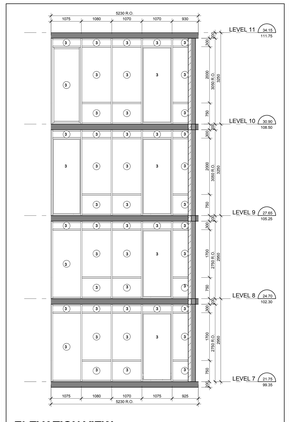

ELEVATION VIEW



FLOOR PLAN VIEW

Interior West Elevation - Part 21 (14 / A4-18)
Scale: 1 : 50

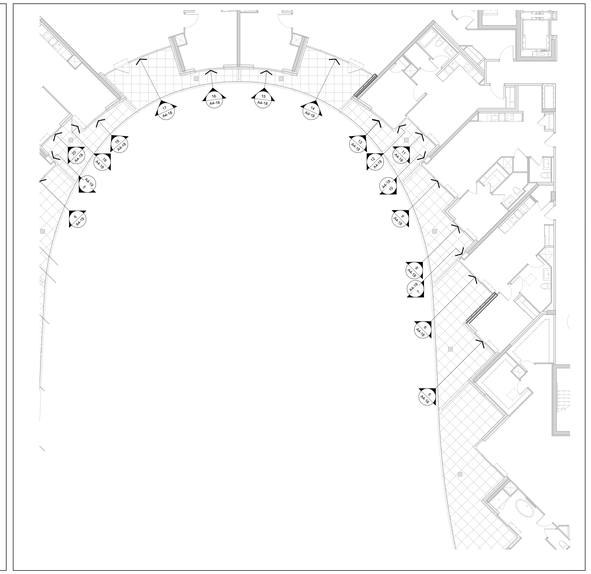

Window Schedule Partial Floor Plan - Level 7 (4 / A4-18)
Scale: 1 : 100

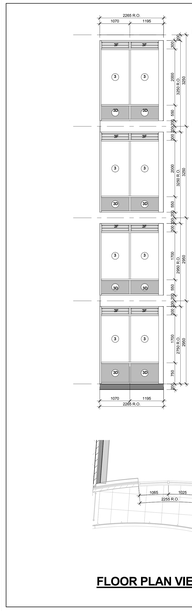

FLOOR PLAN VIEW

Interior West Elevation - Part 20 (13 / A4-18)
Scale: 1 : 50

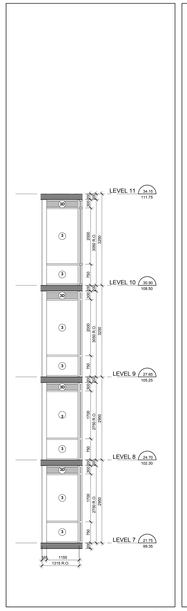

Interior West Elevation - Part 19 (12 / A4-18)
Scale: 1 : 50

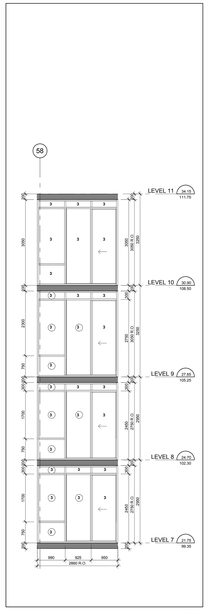

Interior West Elevation - Part 18 (11 / A4-18)
Scale: 1 : 50

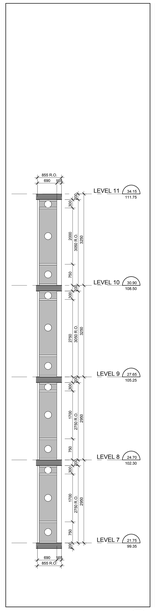

Interior West - Part 17 (10 / A4-18)
Scale: 1 : 50

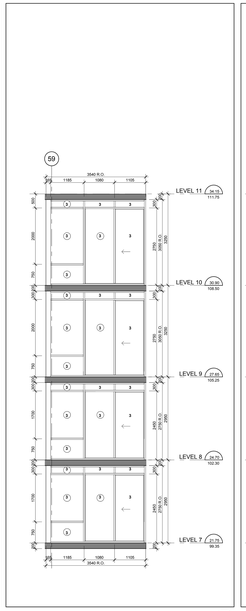

Interior West Elevation - Part 16 (9 / A4-18)
Scale: 1 : 50

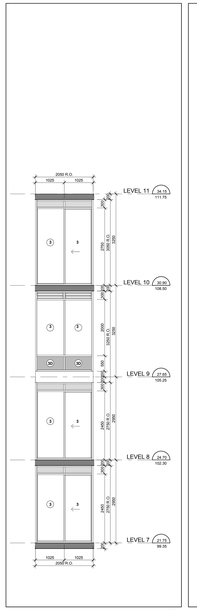

Interior West Elevation - Part 15 (8 / A4-18)
Scale: 1 : 50

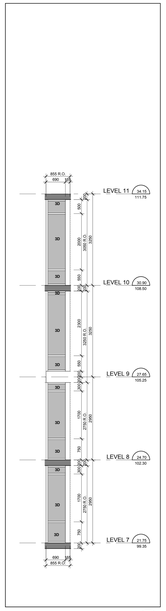

Interior West - Part 14 (7 / A4-18)
Scale: 1 : 50

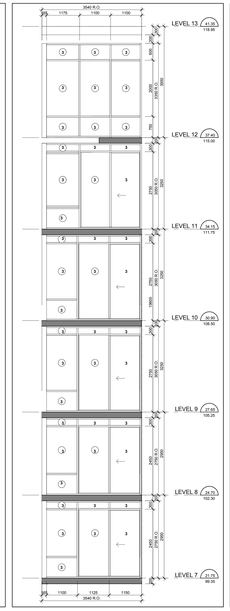

Interior West Elevation - Part 13 (6 / A4-18)
Scale: 1 : 50

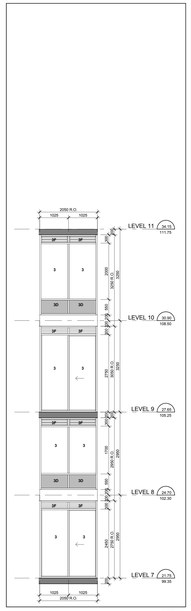

Interior West Elevation - Part 12 (5 / A4-18)
Scale: 1 : 50

TYPICAL WINDOW SCHEDULE NOTES:

1. ADD 10MM CAULKING ALLOWANCE ON ONE OR BOTH SIDES OF WINDOW OPENING.
2. CO-ORDINATE WINDOW SILL HEIGHTS WITH INTERIOR DESIGN.
3. CO-ORDINATE LOUVER LOCATIONS WITH MECHANICAL DRAWINGS.
4. CO-ORDINATE STC GLAZING REQUIREMENTS WITH ACOUSTICAL REPORT.
5. CO-ORDINATE BALCONY/TERRACE ELECTRICAL OUTLETS WITH ELECTRICAL DRAWINGS.

OBC REQUIREMENTS

9.7.1 GENERAL STANDARDS
9.7.2.1 WINDOW STANDARDS
(N) WINDOWS SHALL CONFORM TO:
(a) CAN/CSA-A440 "WINDOWS",
(b) THE CANCSA-A440.1 "USER SELECTION GUIDE TO CSA STANDARD CANCSA-A440-00 WINDOWS".
9.7.2.10.(4)(5)
(a) GLASS SHALL CONFORM TO:
(i) GLASS SHALL CONFORM TO,
(A) CAN/CGSB-12.1-M, "TEMPERED OR LAMINATED SAFETY GLASS",
(B) CAN/CGSB-12.2-M, "FLAT, CLEAR FLOAT GLASS",
(C) CAN/CGSB-12.3-M, "FLAT, CLEAR FLOAT GLASS",
(D) CAN/CGSB-12.4-M, "HEAT-WEDGEMING GLASS",
(E) CAN/CGSB-12.5-M, "WIRED GLASS",
(F) CAN/CGSB-12.10-M, "GLASS, LIGHT AND HEAT-DEFLECTING",
(G) CAN/CGSB-12.11-M, "WIRED SAFETY GLASS",
(H) ASTM E2190, "INSULATING GLASS UNIT PERFORMANCE AND EVALUATION".
(ii) GLASS IN WINDOWS SHALL BE:
(E) GLASS IN WINDOWS, SLOPED GLAZING AND SKYLIGHTS SHALL BE DESIGNED IN CONFORMANCE WITH CAN/CSSB-12.20-M, "STRUCTURAL DESIGN OF GLASS FOR BUILDINGS".
9.7.3.1 SEALING COMPOUND
9.7.4.1 SEALING COMPOUND
(b) THE SEALING COMPOUND USED TO SEAL THE GLASS COMPONENT OF A FACTORY-SEALED DOUBLE-GLAZED UNIT TO THE SASH COMPONENT SHALL BE COMPATIBLE WITH THE MATERIAL USED TO EDGE SEAL THE GLASS COMPONENT.

9.7.6.4. WINDOWS ABOVE THE SECOND STOREY
(1) WINDOWS ABOVE THE SECOND STOREY NOT LESS THAN 1 000 MM FROM THE FLOOR AND ARE LOCATED ABOVE THE SECOND STOREY IN BUILDINGS OF RESIDENTIAL OCCUPANCY SHALL BE:
(a) PROTECTED BY GUARDS IN ACCORDANCE WITH SUBSECTION 9.8.8., OR
(b) PROTECTED BY GUARDS DESIGNED TO WITHSTAND THE LATERAL DESIGN LOADS FOR GUARDS AS PROVIDED IN ARTICLES 4.1.5.10. OR 9.8.8.2.(2)

9.7.6.5. ACCESS TO FORCED ENTRY
9.7.6.1. FORCED ENTRY THROUGH WINDOWS
(1) WINDOWS ABOVE THE SECOND STOREY OF WHICH IS LOCATED WITHIN 2 000 MM OF ADJACENT GROUND LEVEL, SHALL CONFORM TO THE REQUIREMENTS FOR RESISTANCE TO FORCED ENTRY AS DESCRIBED IN CLAUSE 10.13 OF CAN/CSA-A440.M, "WINDOWS".

9.8.8.1. REQUIRED GUARDS
(1)EXCEPT AS PROVIDED IN SENTENCES (2) AND (3), EVERY SURFACE TO WHICH ACCESS IS PROVIDED FOR OTHER THAN MAINTENANCE PURPOSES AND THAT IS LOCATED MORE THAN 600 MM ABOVE ADJACENT GROUND LEVEL, INCLUDING BALCONIES, LANDINGS AND RAMPS, SHALL BE PROTECTED BY A GUARD ON EACH SIDE THAT IS NOT PROTECTED BY A WALL FOR THE LENGTH WHERE:
(a) THE ADJACENT SURFACE WITHIN 1.2 M FROM THE WALKING SURFACE HAS A SLOPE OF LESS THAN 1 IN 2 PERPENDICULAR TO THE ADJACENT SURFACE, OR
(b) THE ADJACENT SURFACE WITHIN 1.2 M FROM THE WALKING SURFACE HAS A SLOPE OF MORE THAN 1 IN 2.
(2) REQUIRED GUARDS
(a) AT LOADING DOCKS,
(b) AT FLOOR PITS IN REPAIR GARAGES, OR
(c) AT PLATFORMS USED FOR MAINTENANCE PURPOSES ONLY.
(3) WHEN AN INTERIOR STAIR HAS MORE THAN 2 RISERS OR AN INTERIOR RAMP RISES MORE THAN 400 MM, THE SIDES OF THE STAIR OR RAMP AND THE LANDING OR FLOOR LEVEL AROUND THE STAIRWELL OR RAMP SHALL BE PROTECTED BY A GUARD ON EACH SIDE THAT IS NOT PROTECTED BY A WALL.

9.8.8.3. HEIGHT OF GUARDS
(1) EXCEPT AS PROVIDED IN SENTENCES (2) TO (4), ALL GUARDS SHALL BE NOT LESS THAN 1 070 MM HIGH.
(2) THE HEIGHT OF GUARDS SERVING NOT MORE THAN ONE DWELLING UNIT SHALL BE NOT LESS THAN 900 MM HIGH WHERE THE WALKING SURFACE SERVED BY THE GUARD IS NOT MORE THAN 1 800 MM ABOVE THE FINISHED GROUND LEVEL.
(3) THE HEIGHT OF GUARDS SERVING OTHER THAN DWELLING UNITS SHALL BE NOT LESS THAN 1 200 MM HIGH.
(4) THE HEIGHT OF GUARDS FOR FLIGHTS OF STEPS SHALL BE MEASURED VERTICALLY FROM A LINE DRAWN THROUGH THE LEADING EDGE OF THE TREADS SERVED BY THE GUARD.

9.8.8.4. GUARD FILLING
(1) A GUARD IN BUILDINGS SHALL BE:
(c) SAFETY GLASS OF THE LAMINATED OR TEMPERED TYPE CONFORMING TO CAN/CGSB-12.1-M, "TEMPERED OR LAMINATED SAFETY GLASS",
OR
(d) WIRED GLASS CONFORMING TO CAN/CGSB-12.11-M, "WIRED SAFETY GLASS".

10.3.2.1. WINDOWS AND GLAZING
(1) EXCEPT AS PERMITTED IN SENTENCES (2) AND (3), WINDOWS AND ALL GLAZING THAT SEPARATES HEATED SPACE FROM UNHEATED SPACE OR THE EXTERIOR SHALL CONFORM TO ARTICLES 10.3.2.5. AND 10.3.2.8.
(2) EXCEPT AS PERMITTED IN SENTENCE (3), WINDOWS AND ALL GLAZING, INCLUDING GLAZING FOR DOORS AND SKYLIGHTS, THAT SEPARATES HEATED SPACE FROM UNHEATED SPACE OR THE EXTERIOR SHALL NOT EXCEED 20 PER CENT OF THE FLOOR AREA OF THE STOREY SERVED BY THE GLAZED AREAS AND SHALL NOT EXCEED 40 PER CENT OF THE TOTAL AREA OF THE WALLS OF THAT STOREY WHERE THE GLAZED AREAS SERVED BY THE GLAZING EXCEED 10 PER CENT OF THE TOTAL AREA OF THE SURFACE WALL, THE AREA OF THE OPAQUE PORTION OF THE WALL IS CALCULATED AS ITS PROJECTED AREA ON A VERTICAL PLANE.
(3) WHERE THE THERMAL RESISTANCE OF GLAZING IS DIFFERENT FROM THAT REQUIRED IN SENTENCE (1) AND ARTICLE 10.3.1.10., THE AREA OF GLAZING SHALL BE DETERMINED BY MULTIPLYING THE ACTUAL AREA OF GLAZING BY THE RATIO OF THE ACTUAL THERMAL RESISTANCE DIVIDED BY THE ACTUAL THERMAL RESISTANCE OF THE GLAZING.
(4) EXCEPT AS PROVIDED IN SENTENCE (5), THE AREA OF GLAZING THAT CONTAINS CLEAR GLASS OR THAT HAS A SHADING COEFFICIENT OF MORE THAN 0.60 SHALL BE CONSIDERED TO BE EQUIVALENT TO THE AREA OF OPAQUE WALL HAVING THE SAME THERMAL RESISTANCE AS THE PART OF ITS UNSHADED AREA IN CALCULATING THE MAXIMUM AREA OF GLAZING IN SENTENCES (2) AND (3) PROVIDED THE BUILDING IS DESIGNED TO BE COOLED (HEATED) BY MECHANICAL EQUIPMENT AND THE SHADING SHALL BE CALCULATED USING THE SUN ANGLES OF JUNE 21 FOR THE PURPOSE OF DETERMINING WHETHER OR NOT THE GLAZING IS SHADED IN THE WINTER, THE SHADING SHALL BE CALCULATED USING THE SUN ANGLES OF DECEMBER 21.
(5) SENTENCE (4) SHALL NOT APPLY WHERE THE BUILDING IS DESIGNED TO BE COOLED (HEATED) USING EQUIPMENT DESCRIBED IN SENTENCE (4) IS SHADED IN THE SUMMER WITH EXTERIOR DEVICES FOR THE PURPOSE OF DETERMINING WHETHER OR NOT THE GLAZING IS SHADED IN THE SUMMER. THE SHADING SHALL BE CALCULATED USING THE NOON SUN ANGLES OF JUNE 21.

10.3.3.13. AIR INFILTRATION
(1) EXTERIOR WINDOWS SEPARATE HEATED SPACE FROM UNHEATED SPACE OR THE EXTERIOR SHALL BE DESIGNED TO LIMIT THE RATE OF AIR INFILTRATION TO NOT MORE THAN 0.775 L/S FOR EACH METRE OF SASH CRACK WHEN TESTED AT PRESSURE DIFFERENTIAL OF 75 PA IN CONFORMANCE WITH ASTM E283, "DETERMINING THE RATE OF AIR LEAKAGE THROUGH EXTERIOR WINDOWS, CURTAIN WALLS, AND DOORS UNDER SPECIFIED PRESSURE DIFFERENCES ACROSS THE SPECIMEN".
(2) MANUALLY OPERATED EXTERIOR SLIDING GLASS DOOR ASSEMBLIES THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE OR THE EXTERIOR SHALL BE DESIGNED TO LIMIT THE RATE OF AIR INFILTRATION TO NOT MORE THAN 0.775 L/S FOR EACH METRE OF DOOR SASH CRACK WHEN TESTED IN CONFORMANCE WITH SENTENCE (1).
(3) EXTERIOR DOORS SHALL BE SELF-CLOSING OR FITTED ON ALL EDGES AND PROTECTED WITH A STORM DOOR OR BY AN ENCLOSED UNHEATED SPACE. EXTERIOR SWING TYPE DOOR ASSEMBLIES FOR DWELLING UNITS, INDIVIDUALLY REDYED HOTEL ROOMS AND SUITES SHALL BE DESIGNED TO LIMIT THE RATE OF AIR INFILTRATION TO NOT MORE THAN 6.35 L/S FOR EACH SQUARE METRE OF DOOR AREA WHEN TESTED IN CONFORMANCE WITH SENTENCE (1).
(4) DOOR ASSEMBLIES OTHER THAN THOSE DESCRIBED IN SENTENCES (2) AND (3), THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE OR THE EXTERIOR SHALL BE DESIGNED TO LIMIT THE RATE OF AIR INFILTRATION TO NOT MORE THAN 17.0 L/S FOR EACH METRE OF DOOR SASH CRACK WHEN TESTED IN CONFORMANCE WITH SENTENCE (1).
(5) CAULKING MATERIAL TO REDUCE AIR INFILTRATION SHALL CONFORM TO THE REQUIREMENTS IN SUBSECTION 9.27.4.
(6) THE JUNCTION BETWEEN THE SILL PLATE AND THE FOUNDATION, JOINTS BETWEEN EXTERIOR WALL PANELS AND ANY OTHER LOCATION WHERE AIR LEAKAGE MAY OCCUR SHALL BE SEALED TO REDUCE AIR INFILTRATION. EXTERIOR WALLS, EXTERIOR WALLS SUCH AS AT UTILITY SERVICE ENTRANCES, SHALL BE CAULKED, GASKETED OR SEALED TO RESTRICT FLOW-THRU LEAKAGE.
(7) THE PENETRATION OF SERVICES SHALL BE RESTRICTED IN CONFORMANCE WITH THE REQUIREMENTS OF SUBSECTION 9.25.3.

Typical Window Schedule Notes (3 / A4-18)
NTS



Window Schedule Key Plan - Level 2 (2 / A4-18)
NTS

WINDOW SCHEDULE LEGEND

13148 - AQUAVISTA
UPDATED: AUGUST 24, 2015

3 PREFINISHED ALUMINUM WINDOW WALL: VISION PANEL
ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET; INTERIOR - PPG DURANCRON K1268 WHITE
GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL 5MM ON SURFACE 2

3A PREFINISHED ALUMINUM WINDOW WALL: VISION PANEL FRIT PATTERN
ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET; INTERIOR - PPG DURANCRON K1268 WHITE
GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL 5MM ON SURFACE 2; WHITE FRIT 5MM DIAMETER DOTS IN 100CM SQUARE PATTERN ON SURFACE 3

3B PREFINISHED ALUMINUM WINDOW WALL: OPERABLE AWNING
ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET; INTERIOR - PPG DURANCRON K1268 WHITE
GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL 5MM ON SURFACE 2

3C PREFINISHED ALUMINUM WINDOW WALL: OPERABLE AWNING FRIT PATTERN
ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET; INTERIOR - PPG DURANCRON K1268 WHITE
GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL 5MM ON SURFACE 2; WHITE FRIT 5MM DIAMETER DOTS IN 100CM SQUARE PATTERN ON SURFACE 3

3D PREFINISHED ALUMINUM WINDOW WALL: GLASS SPANDREL PANEL
ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET; INTERIOR - PPG DURANCRON K1268 WHITE
GLASS TYPE: SOLID FRIT VIRACON SUBDUED GRAY VISO ON SURFACE 2
COLOUR:

3E PREFINISHED ALUMINUM WINDOW WALL: METAL SPANDREL PANEL
ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET; INTERIOR - PPG DURANCRON K1268 WHITE
METAL PANEL: PPG UCTE21NF DURANAR GREY VELVET

3F PREFINISHED ALUMINUM WINDOW WALL: METAL LOUVER
ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET; INTERIOR - PPG DURANCRON K1268 WHITE
METAL LOUVER: PPG UCTE21NF DURANAR GREY VELVET

3G PREFINISHED ALUMINUM WINDOW WALL: METAL SLAB COVER
ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET; INTERIOR - PPG DURANCRON K1268 WHITE
SLAB COVER: PPG UCTE21NF DURANAR GREY VELVET; METAL SILVER CITY

4 PREFINISHED STOREFRONT CURTAINWALL: VISION PANEL (GROUND FLOOR)
ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET; INTERIOR - PPG UCTE21NF DURANAR GREY VELVET
GLASS TYPE: CLEAR INNER & OUTER LITE

4A PREFINISHED STOREFRONT CURTAINWALL: VISION PANEL FRIT PATTERN (GROUND FLOOR)
ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET; INTERIOR - PPG UCTE21NF DURANAR GREY VELVET
GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL 5MM ON SURFACE 2; WHITE FRIT 5MM DIAMETER DOTS IN 100CM SQUARE PATTERN ON SURFACE 3

4B PREFINISHED STOREFRONT CURTAINWALL: SHADOW BOX (GROUND FLOOR)
ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET; INTERIOR - PPG UCTE21NF DURANAR GREY VELVET
GLASS TYPE: CLEAR INNER & OUTER LITE, SOLID FRIT VIRACON SUBDUED GRAY ON SURFACE 4

4C PREFINISHED STOREFRONT CURTAINWALL: GLASS SPANDREL PANEL (GROUND FLOOR)
ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET; INTERIOR - PPG UCTE21NF DURANAR GREY VELVET
GLASS TYPE: CLEAR
COLOUR: SOLID FRIT WARM GREY ON SURFACE 4

4D PREFINISHED STOREFRONT CURTAINWALL: METAL LOUVER (GROUND FLOOR)
ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET; INTERIOR - PPG UCTE21NF DURANAR GREY VELVET
METAL LOUVER: PPG UCTE21NF DURANAR GREY VELVET

4E PREFINISHED STOREFRONT CURTAINWALL: METAL SPANDREL PANEL (GROUND FLOOR)
ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET; INTERIOR - PPG UCTE21NF DURANAR GREY VELVET
METAL PANEL: PPG UCTE21NF DURANAR GREY VELVET

LEGEND

BBQ	BBQ GAS CONNECTION - REFER TO MECHANICAL DRAWINGS
NFHB	NON FREEZE HOSE BIBB - REFER TO MECHANICAL DRAWINGS
WDR	WEATHERPROOF DUPLEX RECEPTACLE - REFER TO ELECTRICAL DRAWINGS
LF	LIGHT FIXTURE - REFER TO ELECTRICAL DRAWINGS
TG	TEMPERED GLASS

Window Schedule Legend (1 / A4-18)
NTS

Contractor Must Check And Verify All Dimensions On The Job.

Do Not Scale The Drawings.

All Drawings, Specifications And Related Documents Are The Copyright Of The Architect And Must Be Returned Upon Request.

Reproduction Of Drawings, Specifications And Related Documents In Part Or Whole Is Forbidden Without The Architects Written Permission.

The Drawing Is Not To Be Used For Construction Until Signed By The Architect.

Date: **October 15, 2015**

SEAL MUST BE SIGNED TO BE VALID

Tender

KIRKOR ARCHITECTS + PLANNERS
20 Martin Ross Avenue, Toronto, Ontario, M3J 2K8
Tel (416) 665-6565, Fx1 (416) 665-1234, www.kirkorarchitects.com

No.	Revision	Date

S.	Tender	Oct. 15, 2015
No.	Issued For	Date

AQUAVISTA
AT BAYSIDE TORONTO

Drawing Title
Window Schedule - Level 7 - Interior West & Interior East Elevation

Project
Hines TRIDEL
AQUAVISTA
Block 3 - R3 & R4
263 Queens Quay East
Toronto, ON

Scale
As indicated

Drawn by
E.V. / M.M.

Checked by
C.A.

Project No.
13148

Date
October 15, 2015

Drawing No.
A4-18

Plot Date: 10/14/2015 12:06:52 PM File Path: C:\Users\mmonck\Documents\Revit 2015 Working Files\13148PCD-Model-Building R3-R4_mmonck (2427).rvt