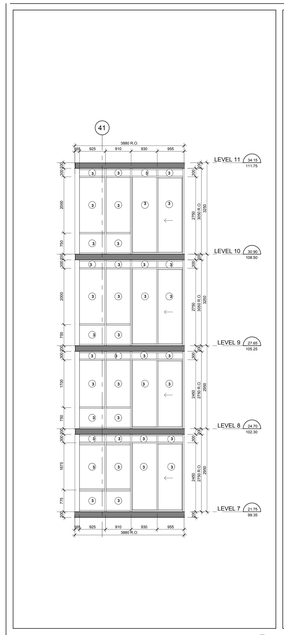

Interior East Elevation - Part 22 (21 / A4-19)
Scale: 1 : 50

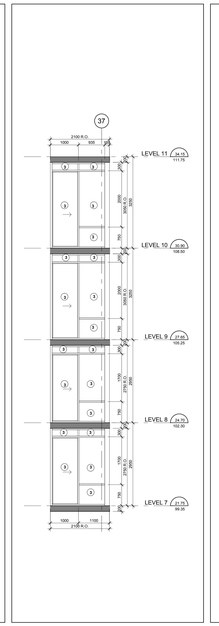

Interior East Elevation - Part 21 (20 / A4-19)
Scale: 1 : 50

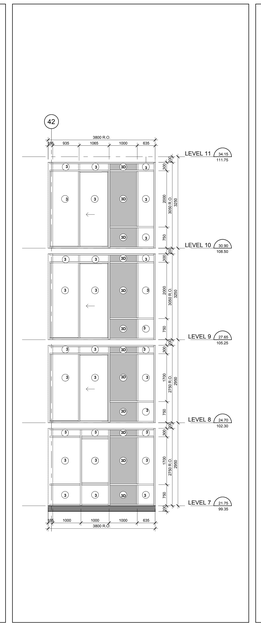

Interior East Elevation - Part 20 (19 / A4-19)
Scale: 1 : 50

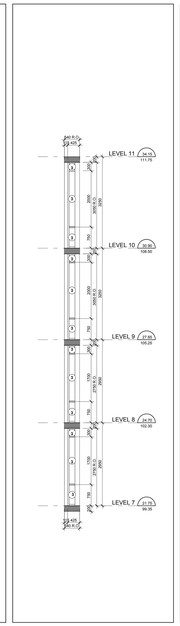

Interior East Elevation - Part 19 (18 / A4-19)
Scale: 1 : 50

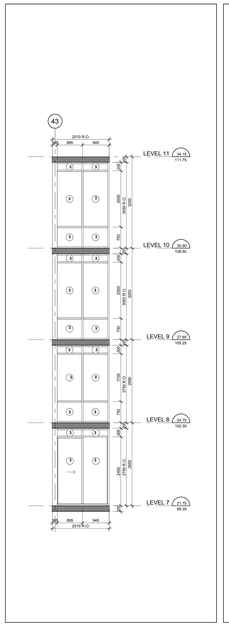

Interior East Elevation - Part 18 (17 / A4-19)
Scale: 1 : 50

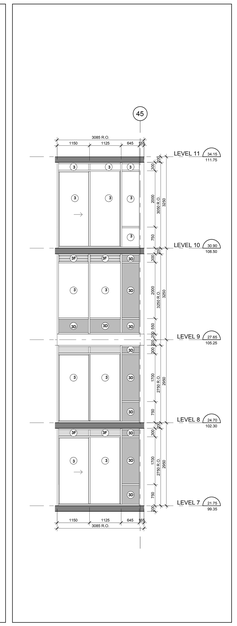

Interior East Elevation - Part 17 - Level 7-10 (16 / A4-19)
Scale: 1 : 50

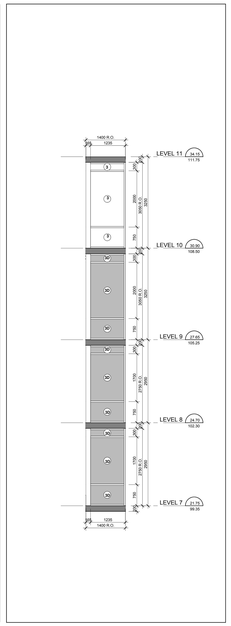

Interior East Elevation - Part 16 (15 / A4-19)
Scale: 1 : 50

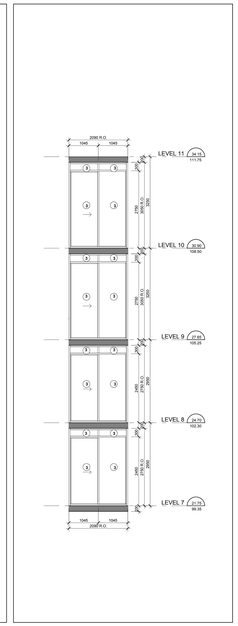

Interior East Elevation - Part 15 (14 / A4-19)
Scale: 1 : 50

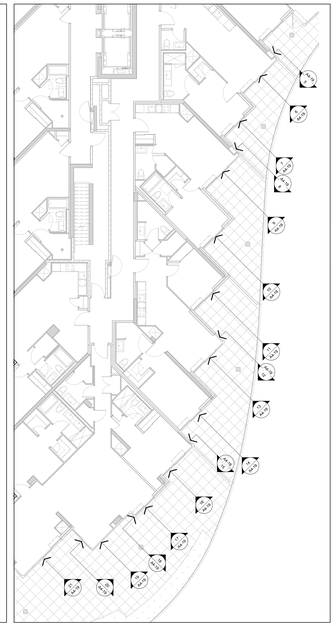

Window Schedule Partial Floor Plan - Level 7 (4 / A4-19)
Scale: 1 : 100

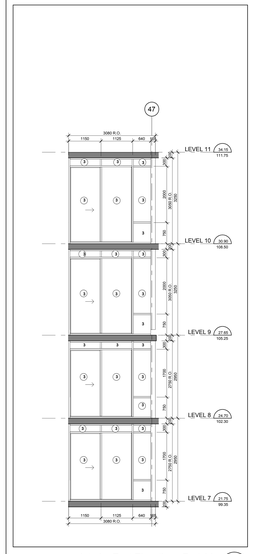

Interior East Elevation - Part 14 (13 / A4-19)
Scale: 1 : 50

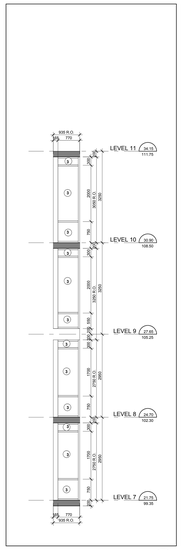

Interior East Elevation - Part 13 (12 / A4-19)
Scale: 1 : 50

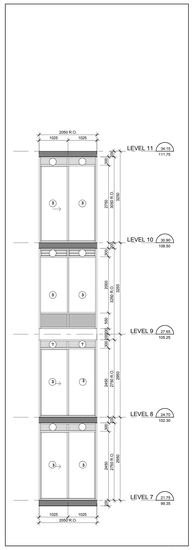

Interior East Elevation - Part 12 (11 / A4-19)
Scale: 1 : 50

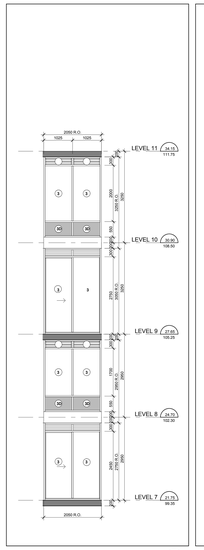

Interior East Elevation - Part 11 (10 / A4-19)
Scale: 1 : 50

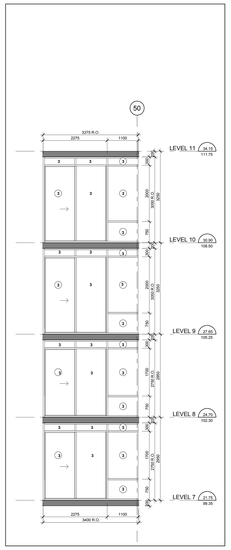

Interior East Elevation - Part 10 (9 / A4-19)
Scale: 1 : 50

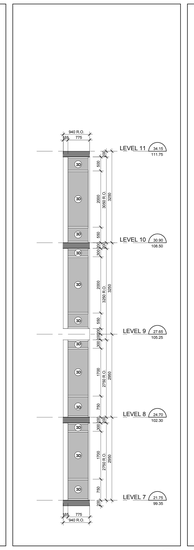

Interior East Elevation - Part 9 (8 / A4-19)
Scale: 1 : 50

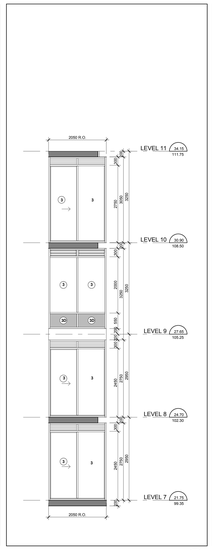

Interior East Elevation - Part 8 (7 / A4-19)
Scale: 1 : 50

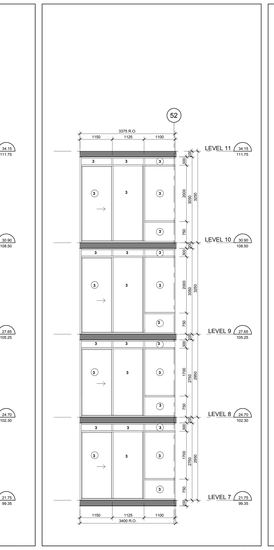

Interior East Elevation - Part 7 (6 / A4-19)
Scale: 1 : 50

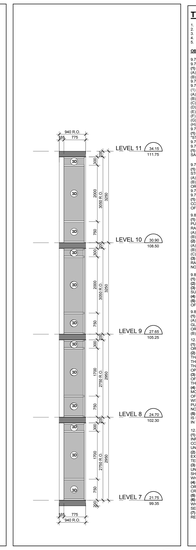

Interior East Elevation - Part 6 (5 / A4-19)
Scale: 1 : 50

## TYPICAL WINDOW SCHEDULE NOTES:

1. ASG VIMN GLAZING ALLOWANCE ON ONE OR BOTH SIDES OF WINDOW OPENING.
2. ALL DOOR AND WINDOW SWINGS AS PER PLANS AND ELEVATIONS.
3. CO-ORDINATE STC GLAZING REQUIREMENTS WITH ACOUSTICAL REPORT.
4. CO-ORDINATE VIBRATION GLAZING REQUIREMENTS WITH ACOUSTICAL REPORT.
5. CO-ORDINATE BALCONY/TERRACE ELECTRICAL OUTLETS WITH ELECTRICAL DRAWINGS.

**OBC REQUIREMENTS**

9.7.2. WINDOW STANDARDS
9.7.2.1. WINDOW STANDARDS
(1) CANCGSB-12.20-M86 (R2010),
(2) CANCGSB-12.8-M77, "WINDOWS", AND
(3) CSA-A440-00 (CSA/AAMA-1), "USER SELECTION GUIDE TO CSA STANDARD CANCSA-A440-00 WINDOWS".
9.7.3. GLAZING
9.7.3.1. GLASS STANDARDS
(1) CANCGSB-12.1-M90, "TEMPERED OR LAMINATED SAFETY GLASS",
(2) CANCGSB-12.3-M, "FLAT, CLEAR SHEET GLASS",
(3) CANCGSB-12.4-M77, "FLOAT GLASS",
(4) CANCGSB-12.8-M, "HEAT-ABSORBING GLASS",
(5) CANCGSB-12.9, "IRREGULATING GLASS UNITS",
(6) CANCGSB-12.11-M90, "WIRED GLASS, TEMPERED/ELECTRIC",
(7) CANCGSB-12.11-M, "WIRED SAFETY GLASS", OR
(8) ASTM E2190, "INSULATING GLASS UNIT PERFORMANCE AND EVALUATION"
9.7.3.2. GLAZING IN WINDOWS
(1) GLASS IN WINDOWS, IN OPEN GLAZING AND SKYLIGHTS SHALL BE DESIGNED IN CONFORMANCE WITH CANCGSB-12.20-M, "STRUCTURAL DESIGN OF GLASS FOR BUILDINGS".
9.7.4. GLAZING AND GLAZING
9.7.4.1. GLAZING SEALS
(1) THE SEALING COMPOUND USED TO SEAL THE GLASS COMPONENT OF A FACTORY-SEALED DOUBLE-GLAZED UNIT TO THE SASH COMPONENT SHALL BE COMPATIBLE WITH THE MATERIAL USED TO EDGE SEAL THE GLASS COMPONENT.

9.7.5.4. WINDOWS ABOVE THE SECOND STOREY
(1) WINDOWS IN PUBLIC AREAS THAT EXTEND TO LESS THAN 1 000 MM FROM THE FLOOR AND ARE LOCATED ABOVE THE SECOND STOREY SHALL BE PROTECTED BY GUARDS IN ACCORDANCE WITH
(A) PROTECTED BY GUARDS IN ACCORDANCE WITH SUBSECTION 9.8.8., OR
(B) NON-OPENABLE AND DESIGNED TO WITHSTAND THE LATERAL DESIGN LOADS FOR GUARDS AS PROVIDED IN ARTICLES 4.1.5.15. AND 4.1.5.16.
9.7.6. RESISTANCE TO FORCED ENTRY
9.7.6.1. FORCED ENTRY THROUGH WINDOWS
(1) EXTERIOR WINDOWS, INCLUDING SKYLIGHTS, OF WHICH IS LOCATED WITHIN 2 000 MM OF ADJACENT GROUND LEVEL, SHALL CONFORM TO THE REQUIREMENTS FOR RESISTANCE TO FORCED ENTRY AS DESCRIBED IN CLAUSE 16.13 OF CAN/CSA-A440.2-M90.
9.8.8.1. REQUIRED GUARDS
(1) EXCEPT AS PROVIDED IN SENTENCES (2) AND (3), EVERY SURFACE TO WHICH ACCESS IS PROVIDED FOR OTHER THAN MAINTENANCE PURPOSES, INCLUDING BUT NOT LIMITED TO FLIGHTS OF STEPS AND RAMPS, EXTERIOR LANDINGS, PORCHES, BALCONIES, GALLERIES AND RAISED WALKWAYS, SHALL BE PROTECTED BY A GUARD ON EACH SIDE THAT IS NOT PROTECTED BY A WALL, WHERE
(A) THERE IS A DIFFERENCE IN ELEVATION OF MORE THAN 600 MM BETWEEN THE WALKING SURFACE AND THE ADJACENT SURFACE, OR
(B) THE ADJACENT SURFACE WITHIN 1.2 M FROM THE WALKING SURFACE HAS A SLOPE OF MORE THAN 1 IN 2
9.8.8.2. EXCEPTIONS
(1) AT LOADING DOCKS,
(A) WHERE ACCESS IS PROVIDED FOR MAINTENANCE PURPOSES ONLY,
(B) WHERE ACCESS IS PROVIDED FOR MAINTENANCE PURPOSES ONLY,
(C) WHERE THE FLOOR OR GROUND SURFACE ADJACENT TO THE RAMP RISES MORE THAN 400 MM, THE SIDES OF THE STAIR OR RAMP AND THE LANDING OR FLOOR LEVEL AROUND THE STAIR(S) OR RAMP SHALL BE PROTECTED BY A GUARD ON EACH SIDE THAT IS NOT PROTECTED BY A WALL.
9.8.8.3. HEIGHT OF GUARDS
(1) EXCEPT AS PROVIDED IN SENTENCES (2) TO (4), ALL GUARDS SHALL BE NOT LESS THAN 1 070 MM HIGH.
(2) EXCEPT AS PROVIDED IN SENTENCE (3), ALL GUARDS SHALL BE NOT LESS THAN 900 MM HIGH WHERE
(A) EXTERIOR GUARDS SERVING NOT MORE THAN ONE DWELLING UNIT SHALL BE NOT LESS THAN 900 MM HIGH WHERE THE WALKING SURFACE WITHIN 1 800 MM HORIZONTALLY OF THE TOP OF THE GUARD IS NOT MORE THAN 1 800 MM ABOVE GRADE,
(B) GUARDS FOR FLIGHTS OF STEPS, EXCEPT AS REQUIRED EXIT STAIRS, SHALL BE NOT LESS THAN 900 MM HIGH.
(3) EXCEPT AS PROVIDED IN SENTENCE (4), HEIGHTS OF STEPS SHALL BE MEASURED VERTICALLY FROM A LINE DRAWN THROUGH THE LEADING EDGE OF THE TREADS SERVED BY THE GUARD.
9.8.8.7. GLASS IN GUARDS
(1) GLASS IN GUARDS SHALL BE,
(A) SAFETY GLASS OF THE LAMINATED OR TEMPERED TYPE CONFORMING TO CAN/CGSB-12.1-M, "TEMPERED OR LAMINATED SAFETY GLASS",
(B) OR
(C) WIRED GLASS CONFORMING TO CAN/CGSB-12.11-M, "WIRED SAFETY GLASS".
12.3.3.11. WINDOWS AND GLAZING
(1) EXCEPT AS PROVIDED IN SENTENCES (2) AND (3), WINDOWS AND ALL GLAZING THAT SEPARATES HEATED SPACE FROM UNHEATED SPACE (B) THE EXTERIOR SHALL CONFORM TO ARTICLES 12.3.2.9. AND 12.3.2.10.
(2) WHERE THE THERMAL RESISTANCE OF GLAZING IS DIFFERENT FROM THAT REQUIRED IN SENTENCE (1) AND ARTICLE 12.3.1.10., THE AREA OF SUCH GLAZING FOR THE PURPOSE OF APPLYING SENTENCE (1) MAY BE ASSUMED AS BEING EQUAL TO THE ACTUAL AREA MULTIPLIED BY THE RATIO OF THE THERMAL RESISTANCE OF THE GLAZING TO THE THERMAL RESISTANCE REQUIRED IN ARTICLE 12.3.1.10.
(3) EXCEPT AS PROVIDED IN SENTENCE (5), THE AREA OF GLAZING THAT CONTAINS CLEAR GLASS OR THAT HAS A SHADING COEFFICIENT OF MORE THAN 0.75 THAT IS UNSHADED IN THE WINTER AND FACES A DIRECTION WITHIN 45° OF DUE SOUTH MAY BE ASSUMED TO BE 50 PERCENT OF THE ACTUAL AREA MULTIPLIED BY THE RATIO OF THE SHADING COEFFICIENT OF THE GLAZING TO 0.75 WHEN THE GLAZING IS SHADED WITH A SYSTEM THAT IS CAPABLE OF DISTRIBUTING THE SOLAR HEAT GAIN FROM SUCH GLASS AREAS THROUGHOUT THE BUILDING FOR THE PURPOSE OF DETERMINING WHETHER OR NOT THE GLAZING IS SHADED IN THE WINTER, THE SHADING SHALL BE CALCULATED USING THE NOON SUN ANGLES OF JANUARY.
(4) SENTENCE (3) SHALL NOT APPLY WHERE THE BUILDING IS DESIGNED TO BE COOLED UNLESS THE GLAZING IS SHADED IN SUMMER THE SHADING SHALL BE CALCULATED USING THE NOON SUN ANGLES OF JULY. SHALL BE CALCULATED USING THE NOON SUN ANGLES OF JUNE 21 IN THE SUMMER. THE SHADING SHALL BE CALCULATED USING THE NOON SUN ANGLES OF JUNE 21.
12.3.3.13. AIR INFILTRATION
(5) WINDOWS THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE OR THE EXTERIOR SHALL BE DESIGNED TO LIMIT THE RATE OF AIR INFILTRATION TO NOT MORE THAN 2.5 L/S FOR EACH SQUARE METRE OF DOOR AREA WHEN TESTED IN CONFORMANCE WITH ASTM E283, "DETERMINING THE RATE OF AIR LEAKAGE THROUGH EXTERIOR WINDOWS, CURTAIN WALLS, AND DOORS UNDER SPECIFIED PRESSURE DIFFERENCES ACROSS THE SPECIMEN".
(6) DOORS THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE OR THE EXTERIOR SHALL BE DESIGNED TO LIMIT AIR INFILTRATION TO NOT MORE THAN 2.5 L/S FOR EACH SQUARE METRE OF DOOR AREA WHEN TESTED IN CONFORMANCE WITH SENTENCE (1).
(7) DOORS THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE OR THE EXTERIOR SHALL BE STRIPPED ON ALL EDGES AND PROTECTED WITH A STORM DOOR OR BY AN ENCLOSED UNHEATED SPACE. EXTERIOR SWING TYPE DOOR ASSEMBLIES FOR DWELLINGS, INDIVIDUAL FLATS PROTECTED WITH STORM DOORS AND ENTRANCE DOORS TO SUITES OF MINOR OCCUPANCY SHALL BE DESIGNED TO LIMIT AIR INFILTRATION TO NOT MORE THAN 2.5 L/S FOR EACH SQUARE METRE OF DOOR AREA WHEN TESTED IN CONFORMANCE WITH SENTENCE (1).
(8) WINDOWS AND ALL GLAZING THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE (A) AND (C). THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE OR THE EXTERIOR SHALL BE DESIGNED TO LIMIT THE RATE OF AIR INFILTRATION TO NOT MORE THAN 17 L/S FOR EACH METRE OF DOOR CRACK WHEN TESTED IN CONFORMANCE WITH SENTENCE (1).
(9) EXTERIOR DOORS, EXCEPT FOR EXIT DOORS, SHALL BE DESIGNED TO CONFORM TO THE REQUIREMENTS IN SUBSECTION 9.27.4.
(B) THE JUNCTION BETWEEN THE SILL PLATE AND THE FOUNDATION, JOINTS BETWEEN EXTERIOR WALL PANELS AND ANY OTHER LOCATION WHERE THERE IS A POSSIBILITY OF AIR LEAKAGE INTO HEATED SPACES IN A BUILDING THROUGH THE EXTERIOR WALLS, SUCH AS AT UTILITY PENETRATIONS, SHALL BE SEALED TO LIMIT AIR LEAKAGE TO NOT MORE THAN 17 L/S FOR EACH METRE OF DOOR
(F) AIR LEAKAGE BETWEEN HEATED SPACE AND ADJACENT ROOF OR ATTIC SPACE CAUSED BY THE PENETRATION OF SERVICES SHALL BE RESTRICTED IN CONFORMANCE WITH THE REQUIREMENTS OF SUBSECTION 9.25.3.

Typical Window Schedule Notes (3 / A4-19)
NTS



Window Schedule Key Plan - Level 2 (2 / A4-19)
NTS

## WINDOW SCHEDULE LEGEND

**13148 - AQUAVISTA**
**UPDATED: AUGUST 24, 2015**

| | | | |
|---|---|---|---|
| | 3 | **PREFINISHED ALUMINUM WINDOW WALL: VISION PANEL** | ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET<br>INTERIOR - PPG DURACRON K1268 WHITE<br>GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL 5MM ON SURFACE 2 |
| | 3A | **PREFINISHED ALUMINUM WINDOW WALL: VISION PANEL FRIT PATTERN** | ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET<br>INTERIOR - PPG DURACRON K1268 WHITE<br>GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL 5MM ON SURFACE 2<br>WHITE FRIT 5MM DIAMETER DOTS IN 100CM SQUARE PATTERN ON SURFACE 3 |
| | 3B | **PREFINISHED ALUMINUM WINDOW WALL: OPERABLE AWNING** | ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET<br>INTERIOR - PPG DURACRON K1268 WHITE<br>GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL 5MM ON SURFACE 2 |
| | 3C | **PREFINISHED ALUMINUM WINDOW WALL: OPERABLE AWNING FRIT PATTERN** | ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET<br>INTERIOR - PPG DURACRON K1268 WHITE<br>GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL 5MM ON SURFACE 2<br>WHITE FRIT 5MM DIAMETER DOTS IN 100CM SQUARE PATTERN ON SURFACE 3 |
| | 3D | **PREFINISHED ALUMINUM WINDOW WALL: GLASS SPANDREL PANEL** | ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET<br>INTERIOR - PPG DURACRON K1268 WHITE<br>GLASS TYPE: CLEAR<br>COLOUR: SOLID FRIT VIRACON SUBDUED GRAY VM20 ON SURFACE 2 |
| | 3E | **PREFINISHED ALUMINUM WINDOW WALL: METAL SPANDREL PANEL** | ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET<br>INTERIOR - PPG DURACRON K1268 WHITE<br>METAL PANEL: PPG UCTE21NF DURANAR GREY VELVET |
| | 3F | **PREFINISHED ALUMINUM WINDOW WALL: METAL LOUVER** | ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET<br>INTERIOR - PPG DURACRON K1268 WHITE<br>METAL LOUVER: PPG UCTE21NF DURANAR GREY VELVET |
| | 3G | **PREFINISHED ALUMINUM WINDOW WALL: METAL SLAB COVER** | ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET<br>INTERIOR - PPG DURACRON K1268 WHITE<br>SLAB COVER: PPG UCTW250NL DURANAR NL STEEL SILVER CITY |
| | 4 | **PREFINISHED STOREFRONT CURTAINWALL: VISION PANEL (GROUND FLOOR)** | ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET<br>INTERIOR - PPG UCTE21NF DURANAR GREY VELVET<br>GLASS TYPE: CLEAR INNER & OUTER LITE |
| | 4A | **PREFINISHED STOREFRONT CURTAINWALL: VISION PANEL FRIT PATTERN (GROUND FLOOR)** | ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET<br>INTERIOR - PPG UCTE21NF DURANAR GREY VELVET<br>GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL 5MM ON SURFACE 2<br>WHITE FRIT 5MM DIAMETER DOTS IN 100CM SQUARE PATTERN ON SURFACE 3 |
| | 4B | **PREFINISHED STOREFRONT CURTAINWALL: SHADOW BOX (GROUND FLOOR)** | ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET<br>INTERIOR - PPG UCTE21NF DURANAR GREY VELVET<br>GLASS TYPE: CLEAR INNER & OUTER LITE, SOLID FRIT VIRACON SUBDUED GRAY ON SURFACE 4 |
| | 4C | **PREFINISHED STOREFRONT CURTAINWALL: GLASS SPANDREL PANEL (GROUND FLOOR)** | ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET<br>INTERIOR - PPG UCTE21NF DURANAR GREY VELVET<br>GLASS TYPE: CLEAR<br>COLOUR: SOLID FRIT WARM GREY ON SURFACE 4 |
| | 4D | **PREFINISHED STOREFRONT CURTAINWALL: METAL LOUVER (GROUND FLOOR)** | ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET<br>INTERIOR - PPG UCTE21NF DURANAR GREY VELVET<br>METAL LOUVER: PPG UCTE21NF DURANAR GREY VELVET |
| | 4E | **PREFINISHED STOREFRONT CURTAINWALL: METAL SPANDREL PANEL (GROUND FLOOR)** | ALUM. COLOUR: EXTERIOR - PPG UCTE21NF DURANAR GREY VELVET<br>INTERIOR - PPG UCTE21NF DURANAR GREY VELVET<br>METAL PANEL: PPG UCTE21NF DURANAR GREY VELVET |

## LEGEND

| | |
|---|---|
| **BRG** | BRG GAS CONNECTION - REFER TO MECHANICAL DRAWINGS |
| **NFHB** | NON FREEZE HOSE BIBB - REFER TO MECHANICAL DRAWINGS |
| **WDR** | WEATHERPROOF DUPLEX RECEPTACLE - REFER TO ELECTRICAL DRAWINGS |
| **LF** | LIGHT FIXTURE - REFER TO ELECTRICAL DRAWINGS |
| **TG** | TEMPERED GLASS |

Window Schedule Legend (1 / A4-19)
NTS

Contractor Must Check And Verify All Dimensions On The Job.

Do Not Scale The Drawings.

All Drawings, Specifications And Related Documents Are The Copyright Of The Architect And Must Be Returned Upon Request.

Reproduction Of Drawings, Specifications And Related Documents In Part Or Whole Is Forbidden Without The Architects Written Permission.

The Drawing Is Not To Be Used For Construction Until Signed By The Architect.

Date: **October 15, 2015**

ALAN G. WILSON ASSOCIATE ARCHITECT
REGISTERED ARCHITECT
LICENCE 6890
STAMP

"SEAL MUST BE VISIBLE TO BE VALID"

Tender

**KIRKOR** ARCHITECTS + PLANNERS
20 Martin Ross Avenue, Toronto, Ontario, M3J 2K8
TAT 0 665-6065, FAX 0 665-1234, www.kirkorarchitects.com

| No.: | Revision | Date |
|---|---|---|
| | | |

| No.: | Issued For | Date |
|---|---|---|
| 1 | Tender | Oct. 15, 2015 |

AQUAVISTA
AT BAYSIDE TORONTO

Drawing Title
Window Schedule - Level 7 - Interior East Elevation

Project
Hines TRIDEL
AQUAVISTA
Block 3 - R3 & R4
263 Queens Quay East
Toronto, ON

Scale: As indicated
Drawn by: E.V. / M.M.
Checked by: C.A.
Project No.: 13148
Date: October 15, 2015
Drawing No.: A4-19