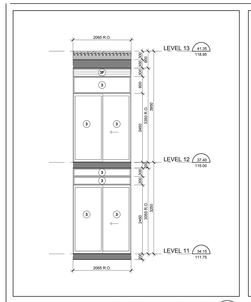

West Elevation - Part 2 (26 / A4-23)
Scale: 1 : 50



West Elevation - Part 1 (25 / A4-23)
Scale: 1 : 50



Interior East Elevation - Part 15 (24 / A4-23)
Scale: 1 : 50



Interior East Elevation - Part 14 (23 / A4-23)
Scale: 1 : 50



Interior East Elevation - Part 13 (22 / A4-23)
Scale: 1 : 50



Interior East Elevation - Part 12 (21 / A4-23)
Scale: 1 : 50

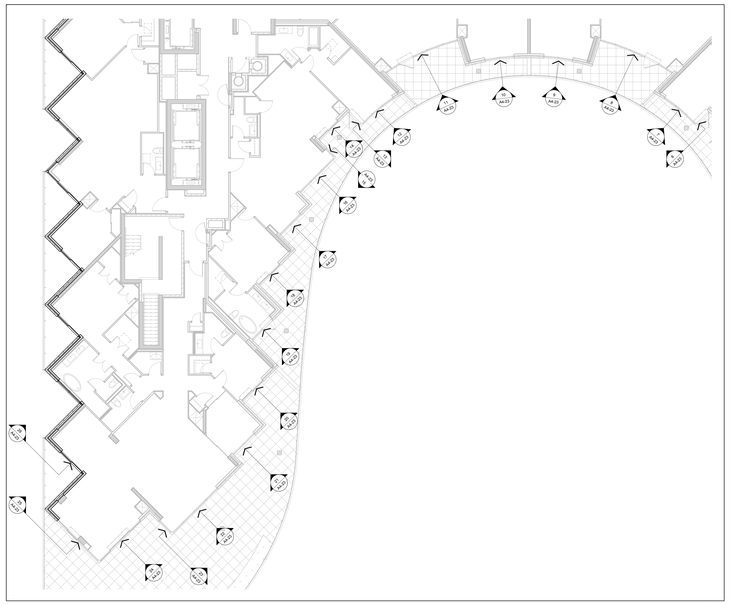

Window Schedule Partial Floor Plan - Level 11 (4 / A4-23)
Scale: 1 : 100



Interior East Elevation - Part 11 (20 / A4-23)
Scale: 1 : 50



Interior East Elevation - Part 10 (19 / A4-23)
Scale: 1 : 50



Interior East Elevation - Part 9 (18 / A4-23)
Scale: 1 : 50



Interior East - Part 8 (17 / A4-23)
Scale: 1 : 50



Interior East Elevation - Part 7 (16 / A4-23)
Scale: 1 : 50



Interior East Elevation - Part 6 (15 / A4-23)
Scale: 1 : 50



ELEVATION VIEW

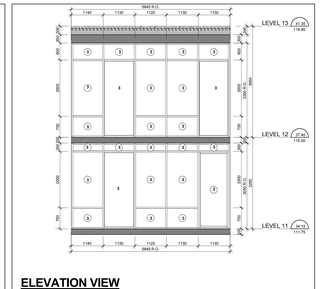

ELEVATION VIEW



ELEVATION VIEW



ELEVATION VIEW

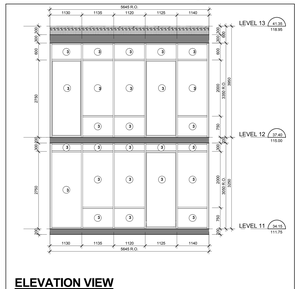

ELEVATION VIEW



ELEVATION VIEW



Interior East Elevation - Part 5 (14 / A4-23)
Scale: 1 : 50



Interior East Elevation - Part 4 (13 / A4-23)
Scale: 1 : 50

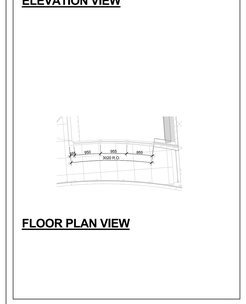

FLOOR PLAN VIEW

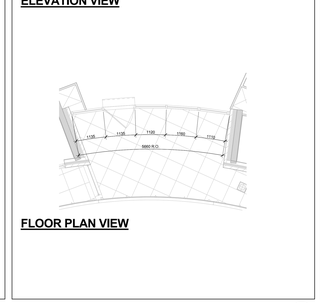

FLOOR PLAN VIEW

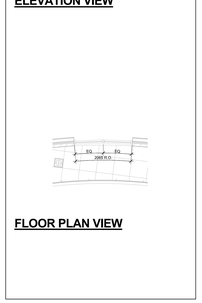

FLOOR PLAN VIEW

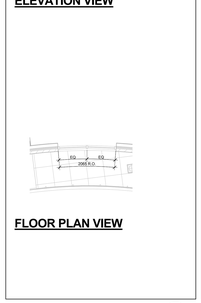

FLOOR PLAN VIEW

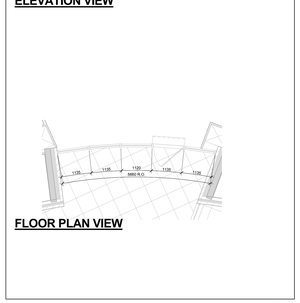

FLOOR PLAN VIEW

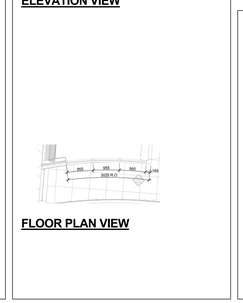

FLOOR PLAN VIEW

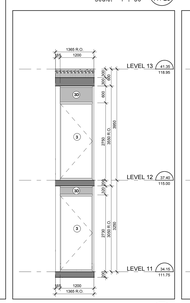

Interior West - Part 11 (6 / A4-23)
Scale: 1 : 50

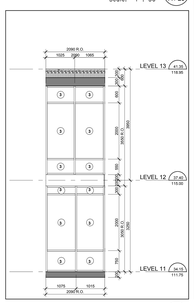

Interior West Elevation - Part 10 (5 / A4-23)
Scale: 1 : 50

Interior East Elevation - Part 3 (12 / A4-23)
Scale: 1 : 50

Interior East Elevation - Part 2 (11 / A4-23)
Scale: 1 : 50

Interior East Elevation - Part 1 (10 / A4-23)
Scale: 1 : 50

Interior West Elevation - Part 14 (9 / A4-23)
Scale: 1 : 50

Interior West Elevation - Part 13 (8 / A4-23)
Scale: 1 : 50

Interior West Elevation - Part 12 (7 / A4-23)
Scale: 1 : 50

TYPICAL WINDOW SCHEDULE NOTES:

1. ADD 10MM CAULKING ALLOWANCE ON ONE OR BOTH SIDES OF WINDOW OPENING.
2. CO-ORDINATE STEEL LINTEL REQUIREMENTS WITH STRUCTURAL DRAWINGS.
3. CO-ORDINATE LOUVER LOCATIONS WITH MECHANICAL DRAWINGS.
4. CO-ORDINATE STC GLAZING REQUIREMENTS WITH ACOUSTICAL REPORT.
5. CO-ORDINATE BALCONY/TERRACE ELECTRICAL OUTLETS WITH ELECTRICAL DRAWINGS.

OBC REQUIREMENTS:

9.7.1. WINDOW STANDARDS
9.7.2. WINDOW STANDARD
(1) WINDOWS SHALL CONFORM TO,
(a) CAN/CSA-A440 "WINDOWS",
(b) THE CANCSA-A440.1, "USER SELECTION GUIDE TO CSA STANDARD CANCSA-A440-00 WINDOWS".
9.7.3. GLASS
9.7.3.1. GLASS STANDARDS
(1) GLASS SHALL CONFORM TO,
(a) CAN/CGSB-12.1-M, "TEMPERED OR LAMINATED SAFETY GLASS",
(b) CAN/CGSB-12.2-M, "FLAT, CLEAR FLOAT GLASS",
(C) CAN/CGSB-12.3-M, "FLAT, CLEAR FLOAT GLASS",
(D) CAN/CGSB-12.8-M, "HEAT ABSORBING GLASS",
(E) CAN/CGSB-12.11-M, "WIRED SAFETY GLASS",
(F) CAN/CGSB-12.19-M, "GLASS, LIGHT AND HEAT REFLECTING",
(G) CAN/CGSB-12.20-M, "STRUCTURAL GLASS",
(H) ASTM E2190, "INSULATING GLASS UNIT PERFORMANCE AND EVALUATION".
9.7.3.2. GLASS IN WINDOWS AND DOORS
(1) GLASS IN WINDOWS, SLOPED GLAZING AND SKYLIGHTS SHALL BE DESIGNED IN CONFORMANCE WITH CANCGSB-12.20-M, "STRUCTURAL DESIGN OF GLASS FOR BUILDINGS".
9.7.4. SEALED COMPONENTS
9.7.4.1. SEALED COMPONENTS
(1) THE SEALED COMPONENT USED TO SEAL THE GLASS COMPONENT OF A FACTORY-SEALED DOUBLE-GLAZED UNIT TO THE SASH COMPONENT SHALL BE COMPATIBLE WITH THE MATERIAL USED TO EDGE SEAL THE GLASS COMPONENT.

9.7.5.4. WINDOWS ABOVE THE SECOND STOREY
(1) WINDOWS LOCATED IN A DWELLING UNIT NOT MORE THAN 1.800 MM FROM THE FLOOR AND ARE LOCATED ABOVE THE SECOND STOREY IN BUILDINGS OF RESIDENTIAL OCCUPANCY SHALL BE,
(a) PROTECTED BY GUARDS IN ACCORDANCE WITH SUBSECTION 9.8.8., OR
(b) DESIGNED TO RESIST FORCES IMPARTED THE LATERAL DESIGN LOADS FOR GUARDS AS PROVIDED IN ARTICLES 4.1.5.15. OR 9.8.8.2
9.7.6. WINDOWS RESISTANCE TO FORCED ENTRY
9.7.6.1. FORCED ENTRY THROUGH WINDOWS
(1) WINDOWS IN DWELLING UNITS NOT PART OF WHICH IS LOCATED WITHIN 2.500 MM OF ADJACENT GROUND LEVEL, SHALL CONFORM TO THE REQUIREMENTS FOR RESISTANCE TO FORCED ENTRY AS DESCRIBED IN CLAUSE 10.13 OF CANCSA-A440.M, "WINDOWS".

9.8.8.1. REQUIRED GUARDS
(a) EXCEPT AS PROVIDED IN SENTENCES (2) TO (4), ALL GUARDS SHALL BE NOT LESS THAN 1.070 MM HIGH.
(b) EXCEPT AS PROVIDED IN SENTENCE (5), ALL GUARDS SHALL BE NOT LESS THAN 1.100 M HIGH.
(c) EXTERIOR GUARDS SERVING NOT MORE THAN ONE DWELLING UNIT SHALL BE NOT LESS THAN 980 MM HIGH WHERE THE WALKING SURFACE SERVED BY THE GUARD IS NOT MORE THAN 1.800 MM ABOVE THE FINISHED GROUND LEVEL.
(d) EXCEPT AS PERMITTED IN SENTENCE (6), GUARDS SHALL BE NOT LESS THAN 1.200 M HIGH WHERE THE WALKING SURFACE SERVED BY THE GUARD IS MORE THAN 1.800 MM ABOVE THE FINISHED GROUND LEVEL.
(e) THE HEIGHT OF GUARDS FOR FLIGHTS OF STEPS SHALL BE MEASURED VERTICALLY FROM A LINE DRAWN THROUGH THE LEADING EDGE OF THE TREADS SERVED BY THE GUARD.
9.8.8.7. GLASS IN GUARDS
(1) GLASS IN GUARDS SHALL BE,
(a) SAFETY GLASS OF THE LAMINATED OR TEMPERED TYPE CONFORMING TO CANCGSB-12.1-M, "TEMPERED OR LAMINATED SAFETY GLASS",
OR
(B) WIRED GLASS CONFORMING TO CANCGSB-12.11-M, "WIRED SAFETY GLASS".
12.3.2.11. WINDOWS AND GLAZING
(1) WINDOWS, DOORS, SKYLIGHTS, VENTILATORS (2) AND (3), WINDOWS AND ALL GLAZING THAT SEPARATES HEATED SPACE FROM UNHEATED SPACE OR THE EXTERIOR SHALL CONFORM TO ARTICLES 12.3.2.5. AND 12.3.2.6.
(2) WINDOWS, DOORS, SKYLIGHTS, VENTILATORS AND ALL OTHER TYPES OF GLAZING, INCLUDING GLAZING FOR DOORS AND SKYLIGHTS, THAT SEPARATES HEATED SPACE FROM UNHEATED SPACE OR THE EXTERIOR SHALL NOT EXCEED 20 PER CENT OF THE FLOOR AREA OF THE STOREY SERVED BY THE GLAZED AREAS AND SHALL NOT EXCEED 40 PER CENT OF THE TOTAL AREA OF THE WALLS OF THAT STOREY SERVED BY THE GLAZED AREAS, WHERE THE AREA OF GLAZING IS CALCULATED AS THE PROJECTED AREA OF THE OPAQUE PORTION OF THE WALL IS CALCULATED AS ITS PROJECTED AREA ON A VERTICAL PLANE.
(3) WHERE THE THERMAL RESISTANCE OF GLAZING IS DIFFERENT FROM THAT REQUIRED IN SENTENCE (1) AND ARTICLE 12.3.1.10, THE AREA OF GLAZING THAT SEPARATES HEATED SPACE FROM UNHEATED SPACE OR THE EXTERIOR SHALL BE CALCULATED USING THE AREA MULTIPLIED BY THE RATIO OF THE REQUIRED THERMAL RESISTANCE DIVIDED BY THE ACTUAL THERMAL RESISTANCE OF THE GLAZING.
(4) EXCEPT AS PROVIDED IN SENTENCE (5), THE AREA OF GLAZING THAT CONTAINS CLEAR GLASS OR THAT HAS A SHADING COEFFICIENT OF 0.60 OR MORE, SHALL BE NOT MORE THAN 0.75 TIMES THE AREA OF GLAZING THAT CONTAINS CLEAR GLASS OR THAT HAS A SHADING COEFFICIENT OF 0.60 OR MORE, WHERE THE AREA OF GLAZING IS CALCULATED USING THE MAXIMUM AREA OF GLAZING IN SENTENCES (2) AND (3) PROVIDED THE BUILDING IS DESIGNED TO SHADE THE GLAZING DESCRIBED IN SENTENCE (4) IN THE SUMMER WITH EXTERIOR DEVICES, FOR THE PURPOSE OF DETERMINING WHETHER OR NOT THE GLAZING IS SHADED IN THE WINTER, THE SHADING SHALL BE CALCULATED USING THE SHADING COEFFICIENT OF THE GLAZING.
(5) SENTENCE (4) SHALL NOT APPLY WHERE THE BUILDING IS DESIGNED TO BE COOLED UNLESS THE GLAZING DESCRIBED IN SENTENCE (4) IS SHADED IN THE SUMMER WITH EXTERIOR DEVICES. FOR THE PURPOSE OF DETERMINING WHETHER OR NOT THE GLAZING IS SHADED IN THE SUMMER, THE SHADING SHALL BE CALCULATED USING THE NOON SUN ANGLES OF JUNE 21.

12.3.3.13. AIR INFILTRATION
(1) WINDOWS SEPARATING HEATED SPACE FROM UNHEATED SPACE OR THE EXTERIOR SHALL BE DESIGNED TO LIMIT THE RATE OF AIR INFILTRATION TO NOT MORE THAN 0.775 L/S PER MM OF SASH PERIMETER OF SASH WHEN TESTED AT PRESSURE DIFFERENTIAL OF 75 PA IN CONFORMANCE WITH ASTM E283 "DETERMINING THE RATE OF AIR LEAKAGE THROUGH EXTERIOR WINDOWS, CURTAIN WALLS, AND DOORS UNDER SPECIFIED PRESSURE DIFFERENCES ACROSS THE ASSEMBLY".
(2) MANUALLY OPERATED EXTERIOR SLIDING GLASS DOOR ASSEMBLIES THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE OR THE EXTERIOR SHALL BE DESIGNED TO LIMIT THE RATE OF AIR INFILTRATION TO NOT MORE THAN 0.25 L/S FOR EACH SQUARE METRE OF DOOR AREA WHEN TESTED IN CONFORMANCE WITH SENTENCE (1).
(3) EXTERIOR DOORS, OTHER THAN THOSE DESCRIBED IN SENTENCES (2) AND (4), THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE OR THE EXTERIOR SHALL BE DESIGNED TO LIMIT THE RATE OF AIR INFILTRATION TO NOT MORE THAN 17.0 L/S FOR EACH METRE OF DOOR CRACK WHEN TESTED IN CONFORMANCE WITH SENTENCE (1).
(4) SKYLIGHTS, OTHER THAN THOSE DESCRIBED IN SENTENCES (2) AND (3), THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE, EXTERIOR SWING TYPE DOOR ASSEMBLIES FOR DWELLING UNITS, INDIVIDUALLY REWIRED HOTEL ROOMS AND SUITES SHALL BE DESIGNED TO LIMIT THE RATE OF AIR INFILTRATION TO NOT MORE THAN 0.35 L/S FOR EACH SQUARE METRE OF DOOR AREA WHEN TESTED IN CONFORMANCE WITH SENTENCE (1).
(5) DOOR ASSEMBLIES OTHER THAN THOSE DESCRIBED IN SENTENCES (2) AND (3), THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE OR THE EXTERIOR SHALL BE DESIGNED TO LIMIT THE RATE OF AIR INFILTRATION TO NOT MORE THAN 17.0 L/S FOR EACH METRE OF DOOR CRACK WHEN TESTED IN CONFORMANCE WITH SENTENCE (1).
(6) CAULKING MATERIAL TO REDUCE AIR INFILTRATION SHALL CONFORM TO THE REQUIREMENTS IN SUBSECTION 9.27.4.
(7) THE JUNCTION BETWEEN THE SILL PLATE AND THE FOUNDATION, JOINTS BETWEEN EXTERIOR WALL PANELS AND ANY OTHER LOCATION, WHERE AIR LEAKAGE WOULD OCCUR SHALL BE SEALED OR GASKETED TO RESTRICT AIR LEAKAGE. EXTERIOR WALLS SUCH AS AT UTILITY SERVICE ENTRANCES, SHALL BE CAULKED, GASKETED OR SEALED TO RESTRICT SUCH AIR LEAKAGE.
(8) AIR LEAKAGE BETWEEN HEATED SPACE AND ADJACENT ROOF OR ATTIC SPACE CAUSED BY THE PENETRATION OF SERVICES SHALL BE RESTRICTED IN CONFORMANCE WITH THE REQUIREMENTS OF SUBSECTION 9.25.3.

Typical Window Schedule Notes (3 / A4-23)
NTS



Window Schedule Key Plan - Level 11 (2 / A4-23)
NTS

WINDOW SCHEDULE LEGEND

13148 - AQUAVISTA
UPDATED: AUGUST 24, 2015

3 — **PREFINISHED ALUMINUM WINDOW WALL: VISION PANEL**
ALUM. COLOUR: EXTERIOR - PPG UC752-14F DURANAR GREY VELVET; INTERIOR - PPG DURACRON K1088 WHITE
GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL SN34 ON SURFACE 2

3A — **PREFINISHED ALUMINUM WINDOW WALL: VISION PANEL FRIT PATTERN**
ALUM. COLOUR: EXTERIOR - PPG UC752-14F DURANAR GREY VELVET; INTERIOR - PPG DURACRON K1088 WHITE
GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL SN34 ON SURFACE 2; WHITE FRIT 5864 DIAMETER DOTS IN 102M SQUARE PATTERN ON SURFACE 3

3B — **PREFINISHED ALUMINUM WINDOW WALL: OPERABLE AWNING**
ALUM. COLOUR: EXTERIOR - PPG UC752-14F DURANAR GREY VELVET; INTERIOR - PPG DURACRON K1088 WHITE
GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL SN34 ON SURFACE 2

3C — **PREFINISHED ALUMINUM WINDOW WALL: OPERABLE AWNING FRIT PATTERN**
ALUM. COLOUR: EXTERIOR - PPG UC752-14F DURANAR GREY VELVET; INTERIOR - PPG DURACRON K1088 WHITE
GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL SN34 ON SURFACE 2; WHITE FRIT 5864 DIAMETER DOTS IN 102M SQUARE PATTERN ON SURFACE 3

3D — **PREFINISHED ALUMINUM WINDOW WALL: GLASS SPANDREL PANEL**
ALUM. COLOUR: EXTERIOR - PPG UC752-14F DURANAR GREY VELVET; INTERIOR - PPG DURACRON K1088 WHITE
GLASS TYPE: CLEAR FLOAT
COLOUR: SOLID FRIT VIRACON SUBDUED GRAY V903 ON SURFACE 2

3E — **PREFINISHED ALUMINUM WINDOW WALL: METAL SPANDREL PANEL**
ALUM. COLOUR: EXTERIOR - PPG UC752-14F DURANAR GREY VELVET; INTERIOR - PPG DURACRON K1088 WHITE
METAL PANEL: PPG UC752-14F DURANAR GREY VELVET

3F — **PREFINISHED ALUMINUM WINDOW WALL: METAL LOUVER**
ALUM. COLOUR: EXTERIOR - PPG UC752-14F DURANAR GREY VELVET; INTERIOR - PPG DURACRON K1088 WHITE
METAL LOUVER: PPG UC752-14F DURANAR GREY VELVET

3G — **PREFINISHED ALUMINUM WINDOW WALL: METAL SLAB COVER**
ALUM. COLOUR: EXTERIOR - PPG UC752-14F DURANAR GREY VELVET; INTERIOR - PPG DURACRON K1088 WHITE
SLAB COVER: PPG UC147B70XL DURANAR AL STEEL SILVER CITY

4 — **PREFINISHED STOREFRONT CURTAINWALL: VISION PANEL (GROUND FLOOR)**
ALUM. COLOUR: EXTERIOR - PPG UC752-14F DURANAR GREY VELVET; INTERIOR - PPG UC752-14F DURANAR GREY VELVET
GLASS TYPE: CLEAR INNER & OUTER LITE

4A — **PREFINISHED STOREFRONT CURTAINWALL: VISION PANEL FRIT PATTERN (GROUND FLOOR)**
ALUM. COLOUR: EXTERIOR - PPG UC752-14F DURANAR GREY VELVET; INTERIOR - PPG UC752-14F DURANAR GREY VELVET
GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL SN34 ON SURFACE 2; WHITE FRIT 5864 DIAMETER DOTS IN 102M SQUARE PATTERN ON SURFACE 3

4B — **PREFINISHED STOREFRONT CURTAINWALL: SHADOW BOX (GROUND FLOOR)**
ALUM. COLOUR: EXTERIOR - PPG UC752-14F DURANAR GREY VELVET; INTERIOR - PPG UC752-14F DURANAR GREY VELVET
GLASS TYPE: CLEAR INNER & OUTER LITE, SOLID FRIT VIRACON SUBDUED GRAY ON SURFACE 4

4C — **PREFINISHED STOREFRONT CURTAINWALL: GLASS SPANDREL PANEL (GROUND FLOOR)**
ALUM. COLOUR: EXTERIOR - PPG UC752-14F DURANAR GREY VELVET; INTERIOR - PPG UC752-14F DURANAR GREY VELVET
GLASS TYPE: CLEAR FLOAT
COLOUR: SOLID FRIT WARM GREY ON SURFACE 4

4D — **PREFINISHED STOREFRONT CURTAINWALL: METAL LOUVER (GROUND FLOOR)**
ALUM. COLOUR: EXTERIOR - PPG UC752-14F DURANAR GREY VELVET; INTERIOR - PPG UC752-14F DURANAR GREY VELVET
METAL LOUVER: PPG UC752-14F DURANAR GREY VELVET

4E — **PREFINISHED STOREFRONT CURTAINWALL: METAL SPANDREL PANEL (GROUND FLOOR)**
ALUM. COLOUR: EXTERIOR - PPG UC752-14F DURANAR GREY VELVET; INTERIOR - PPG UC752-14F DURANAR GREY VELVET
METAL PANEL: PPG UC752-14F DURANAR GREY VELVET

LEGEND

BBQ	BBQ GAS CONNECTION - REFER TO MECHANICAL DRAWINGS
NFHB	NON-FREEZE HOSE BIBB - REFER TO MECHANICAL DRAWINGS
WDR	WEATHERPROOF DUPLEX RECEPTACLE - REFER TO ELECTRICAL DRAWINGS
LF	LIGHT FIXTURE - REFER TO ELECTRICAL DRAWINGS
TG	TEMPERED GLASS

Window Schedule Legend (1 / A4-23)
NTS

Contractor Must Check And Verify All Dimensions On The Job.
Do Not Scale The Drawings.
All Drawings, Specifications And Related Documents Are The Copyright Of The Architect And Must Be Returned Upon Request.
Reproduction Of Drawings, Specifications And Related Documents In Part Or Whole Is Prohibited Without The Architects Written Permission.
The Drawing Is Not To Be Used For Construction Until Signed By The Architect.

Date: October 15, 2015

KIRKOR ARCHITECTS + PLANNERS
20 Martin Ross Avenue, Toronto, Ontario, M3J 2K8
Tel (416) 665-6565, Fax (416) 665-1234, www.kirkorarchitects.com

No.	Revision	Date

S.	Tender	Oct. 15, 2015
No.	Issued For	Date

AQUAVISTA
AT BAYSIDE TORONTO

Drawing Title
Window Schedule - Level 11 - Interior West, Interior East & West Elevation

Project
Hines TRIDEL
AQUAVISTA
Block 3 - R3 & R4
263 Queens Quay East
Toronto, ON

Scale: As indicated
Drawn by: E.V. / M.M.
Checked by: C.A.
Project No.: 13148
Date: October 15, 2015
Drawing No.: A4-23