


REVISIONS		10/15/15
1.0	ISSUED FOR TENDER	10/15/15
2.0	ISSUED FOR TENDER	10/23/15
APPENDIX #1		


NOTES

- NOTES - RESIDENTIAL SIDEWALL SPRINKLERS:
1. MAXIMUM COVER/AGE FOR RESIDENTIAL SIDEWALL SPRINKLERS NOT TO EXCEED 16 x 16.
 2. MAXIMUM DISTANCE BETWEEN SPRINKLERS TO BE 8'-0".
 3. MAXIMUM DISTANCE FROM ANY SIDE WALL TO SPRINKLER NOT TO EXCEED 8'-0".
 4. SIDEWALL SPRINKLERS SHALL BE LOCATED AT LEAST 3'-0" FROM OBSTRUCTIONS SUCH AS CEILING FANS AND LIGHT FIXTURES.
 5. SEE OBSTRUCTION TABLE ON DRAWING SET.
- NOTES - RESIDENTIAL PENDENT SPRINKLERS:
1. MAXIMUM COVER/AGE FOR RESIDENTIAL PENDENT SPRINKLERS NOT TO EXCEED 17 ft².
 2. MAXIMUM DISTANCE BETWEEN SPRINKLERS TO BE 8'-0".
 3. MAXIMUM DISTANCE FROM ANY SIDE WALL TO SPRINKLER NOT TO EXCEED 8'-0".
 4. PENDENT SPRINKLERS SHALL BE LOCATED AT LEAST 3'-0" FROM OBSTRUCTIONS SUCH AS CEILING FANS AND LIGHT FIXTURES.
 5. SEE OBSTRUCTION TABLE ON DRAWING SET.

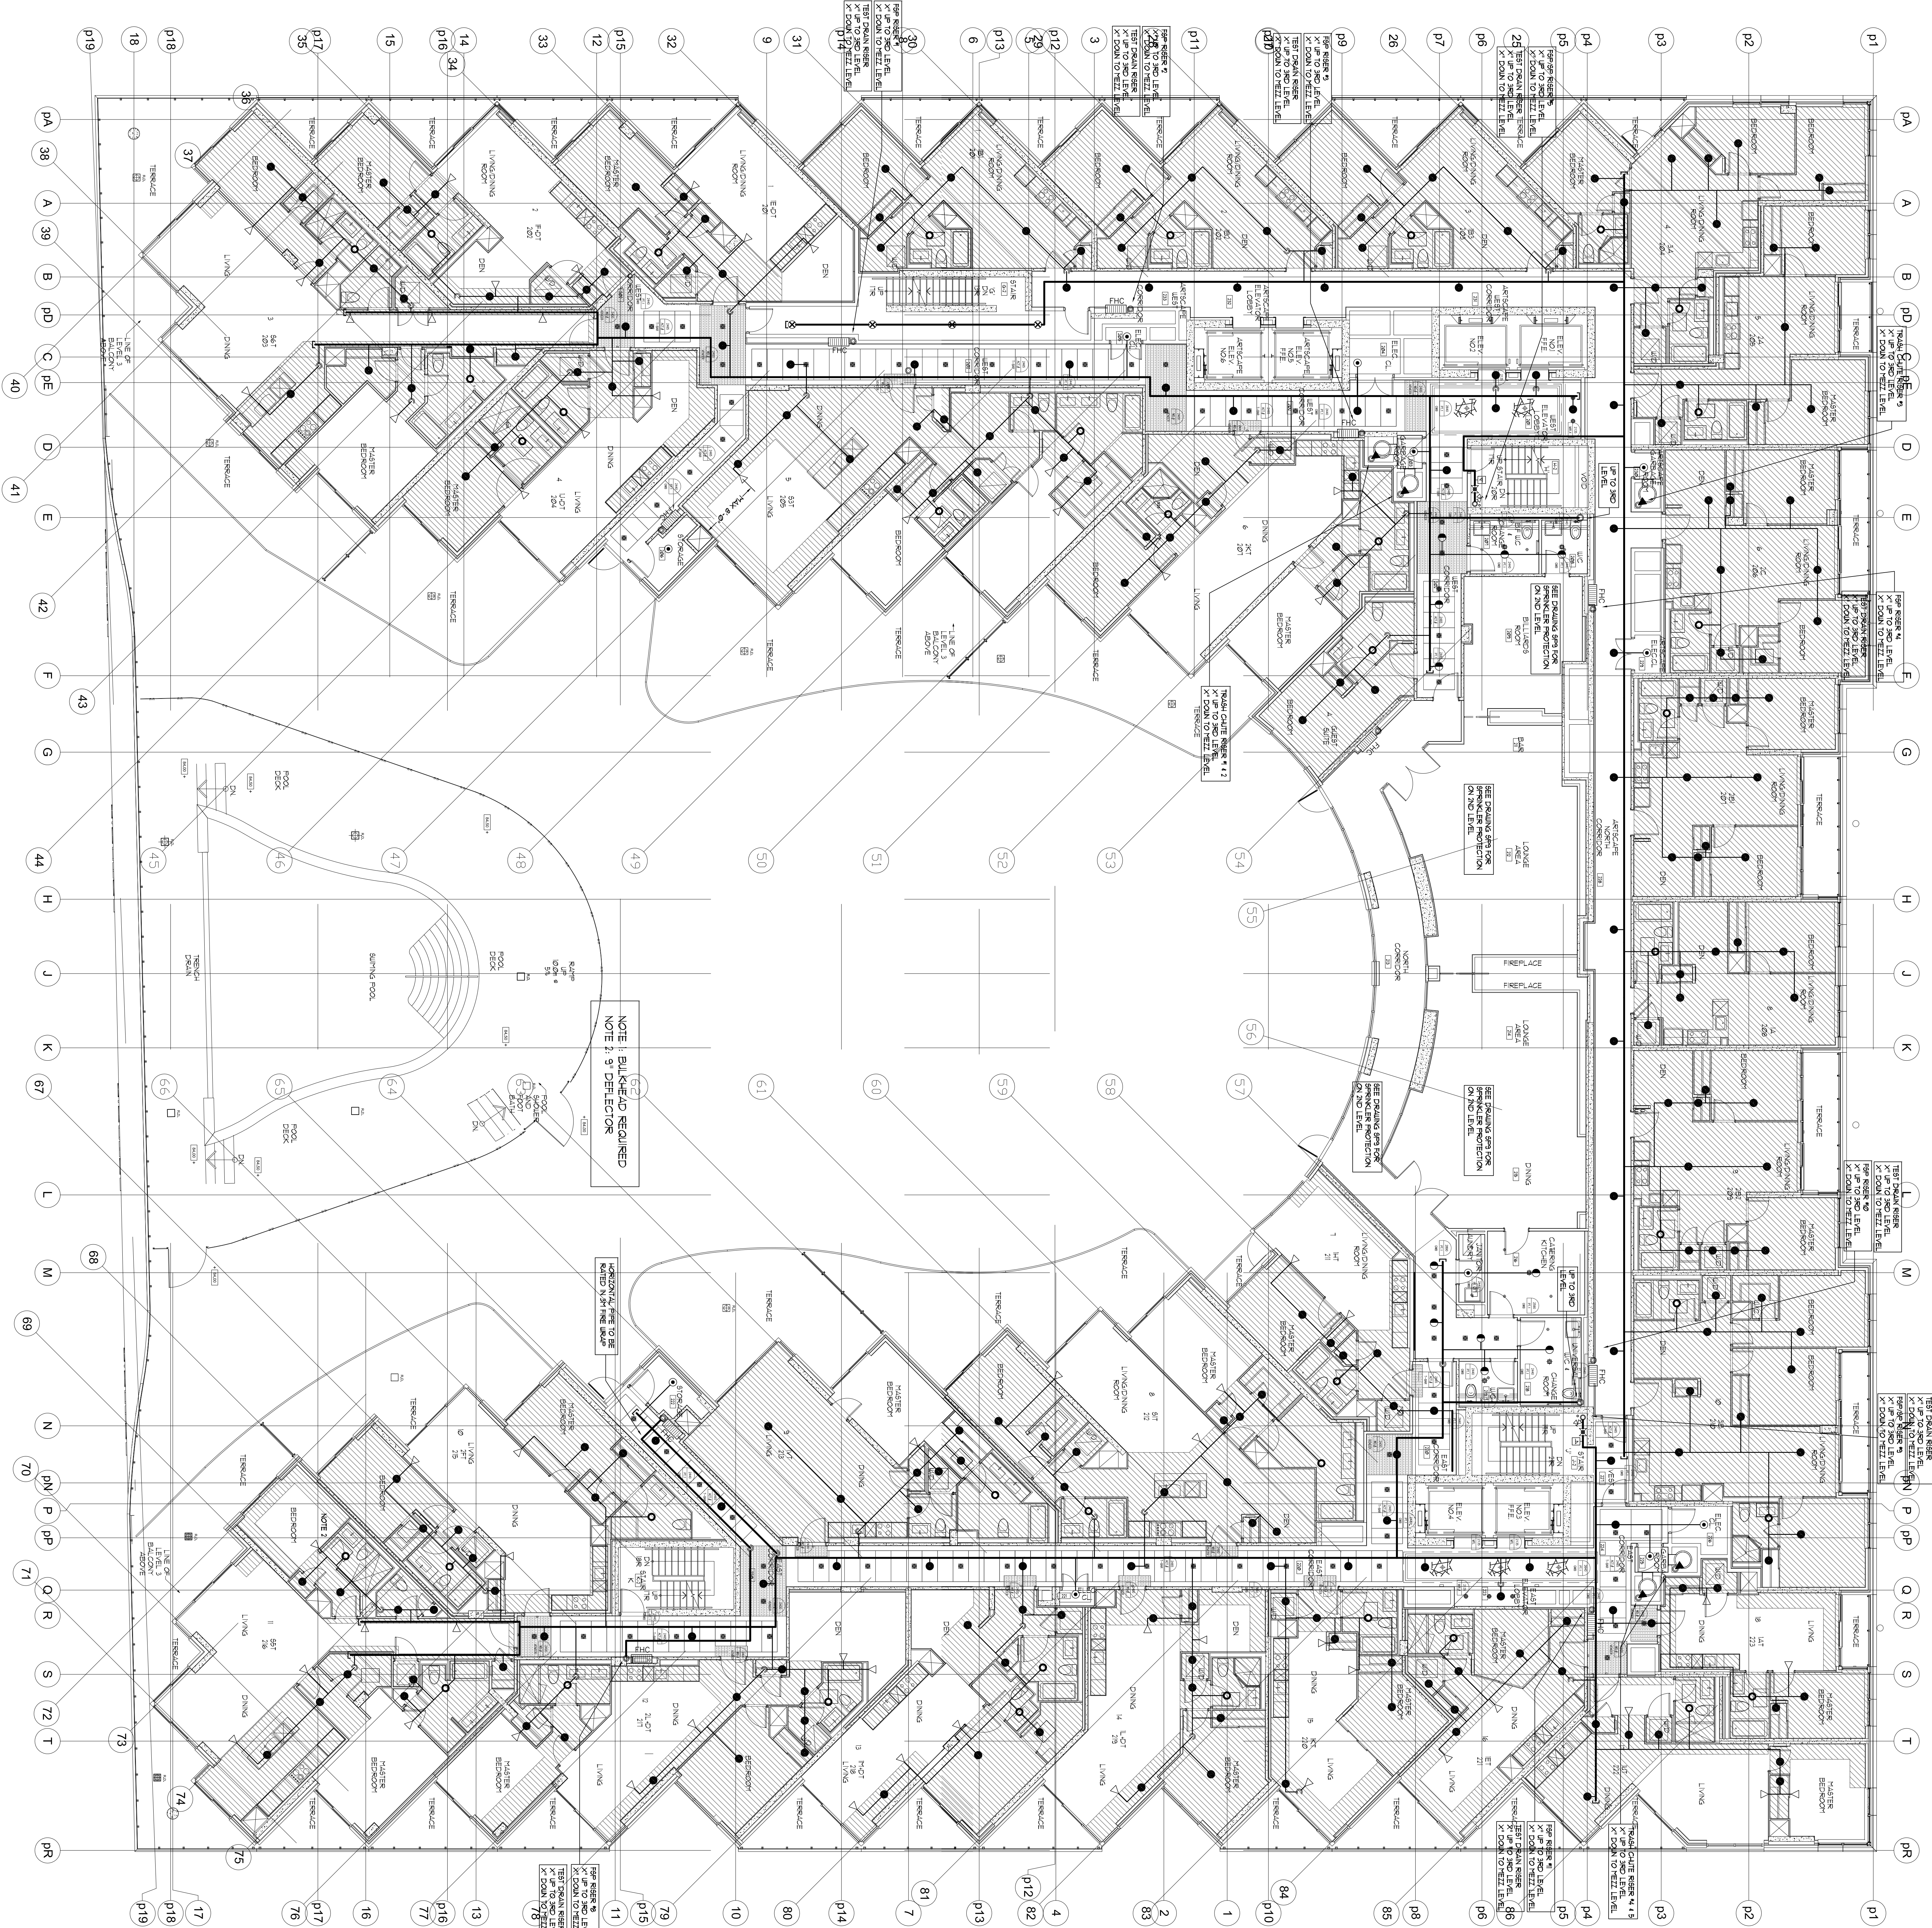

2ND FLOOR SPRINKLER LAYOUT
SCALE: 1/8"=1'-0"

PROJECT	AQUAVISTA
DESIGNER	MERIDIAN WATERWORKS, INC.
DWG. TITLE	2ND LEVEL SPRINKLER LAYOUT
DATE	10/23/2015
SCALE	1/8"=1'-0"
DWG. BY	JL
DESIGNED FOR	SP8
REVISION NO.	2.0
OF SP21	

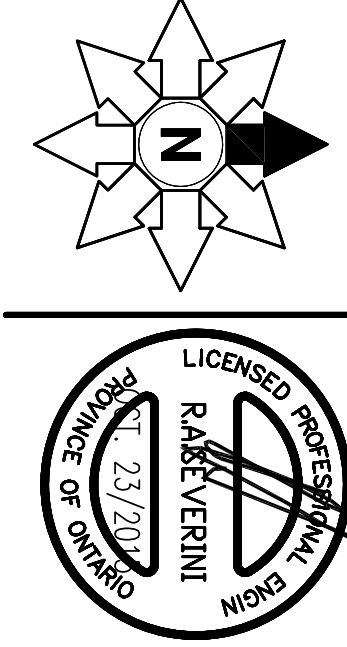

MIRENDA
INCORPORATED
15171 Yonge Street Suite 202
Aurora Ontario M4G 1M1
(416) 565-7770
(416) 565-7771

TRIDEL
BUILT FOR LIFE
4800 Dufferin Street S101
Toronto, Ontario M3J 5S9
(416) 467-8120

SPRINKLER LEGEND	
1/2" 155T SC 58 BRASS	4
UPRIGHT SPRINKLER K=5.6	4
1/2" 155T SC 58 CONCEALED	11
PENDENT SPRINKLER K=5.6 LH	11
1/2" 155T SC 58 BRASS	11
UPRIGHT SPRINKLER K=5.6 OH	11
WINKING MODEL W4547 FREEDOM	269
ESSENTIAL COVERED PENDENT COVER PLATE K=4.9 155T	269
WINKING MODEL W4547 FREEDOM	40
SPRINKLER C/W WHITE 3-5/16" EPOXY CORROSION RESISTANT COATING	40
WINKING MODEL W4547 FREEDOM	59
ESSENTIAL SPRINKLER C/W WHITE 155T 8" DEFLECTOR UNO (MAXIMUM COVERAGE 16X18 UNO)	59
1/2" 155T SC 58 SIDEWALL	5
SPRINKLER K=5.6 OH	5
FIRE HOSE CABINET	10
SEE DETAIL SHEET SP1	10