

- MEP SHAFT LEGEND**
- A 2ND FA AFFORDABLE SECONDARY FRESH AIR SHAFT
 - A BLR-CHL AFFORDABLE BOILER & CHILLER PIPE SHAFT
 - A ELEC AFFORDABLE ELECTRIC CLOSET
 - A HVAC P AFFORDABLE HVAC PIPE SHAFT
 - A MN FA AFFORDABLE MAIN FRESH AIR SHAFT
 - A MN P AFFORDABLE MAIN PIPE SHAFT
 - A TR RM AFFORDABLE TRASH ROOM
 - C 2ND FA CONDO SECONDARY FRESH AIR SHAFT
 - C 2ND P CONDO SECONDARY PIPE SHAFT
 - C AMN FA CONDO AMENITY FRESH AIR SHAFT
 - C BLR-CHL CONDO BOILER & CHILLER PIPE SHAFT
 - C ELEC CONDO ELECTRIC CLOSET
 - C MN FA CONDO MAIN FRESH AIR SHAFT
 - C MN P CONDO MAIN PIPE SHAFT
 - C TR RM CONDO TRASH ROOM
 - R BLR RETAIL BOILER PIPE SHAFT
 - R CHL RETAIL CHILLER PIPE SHAFT
 - RST EXH RESTAURANT KITCHEN EXHAUST


94.2


IS THERE A
TRANSFER SLAB
IN L3 SLAB?
(SHADED AREA)

94.3

DOES THIS COLUMN
STAY ON THIS LEVEL?

100%
ac

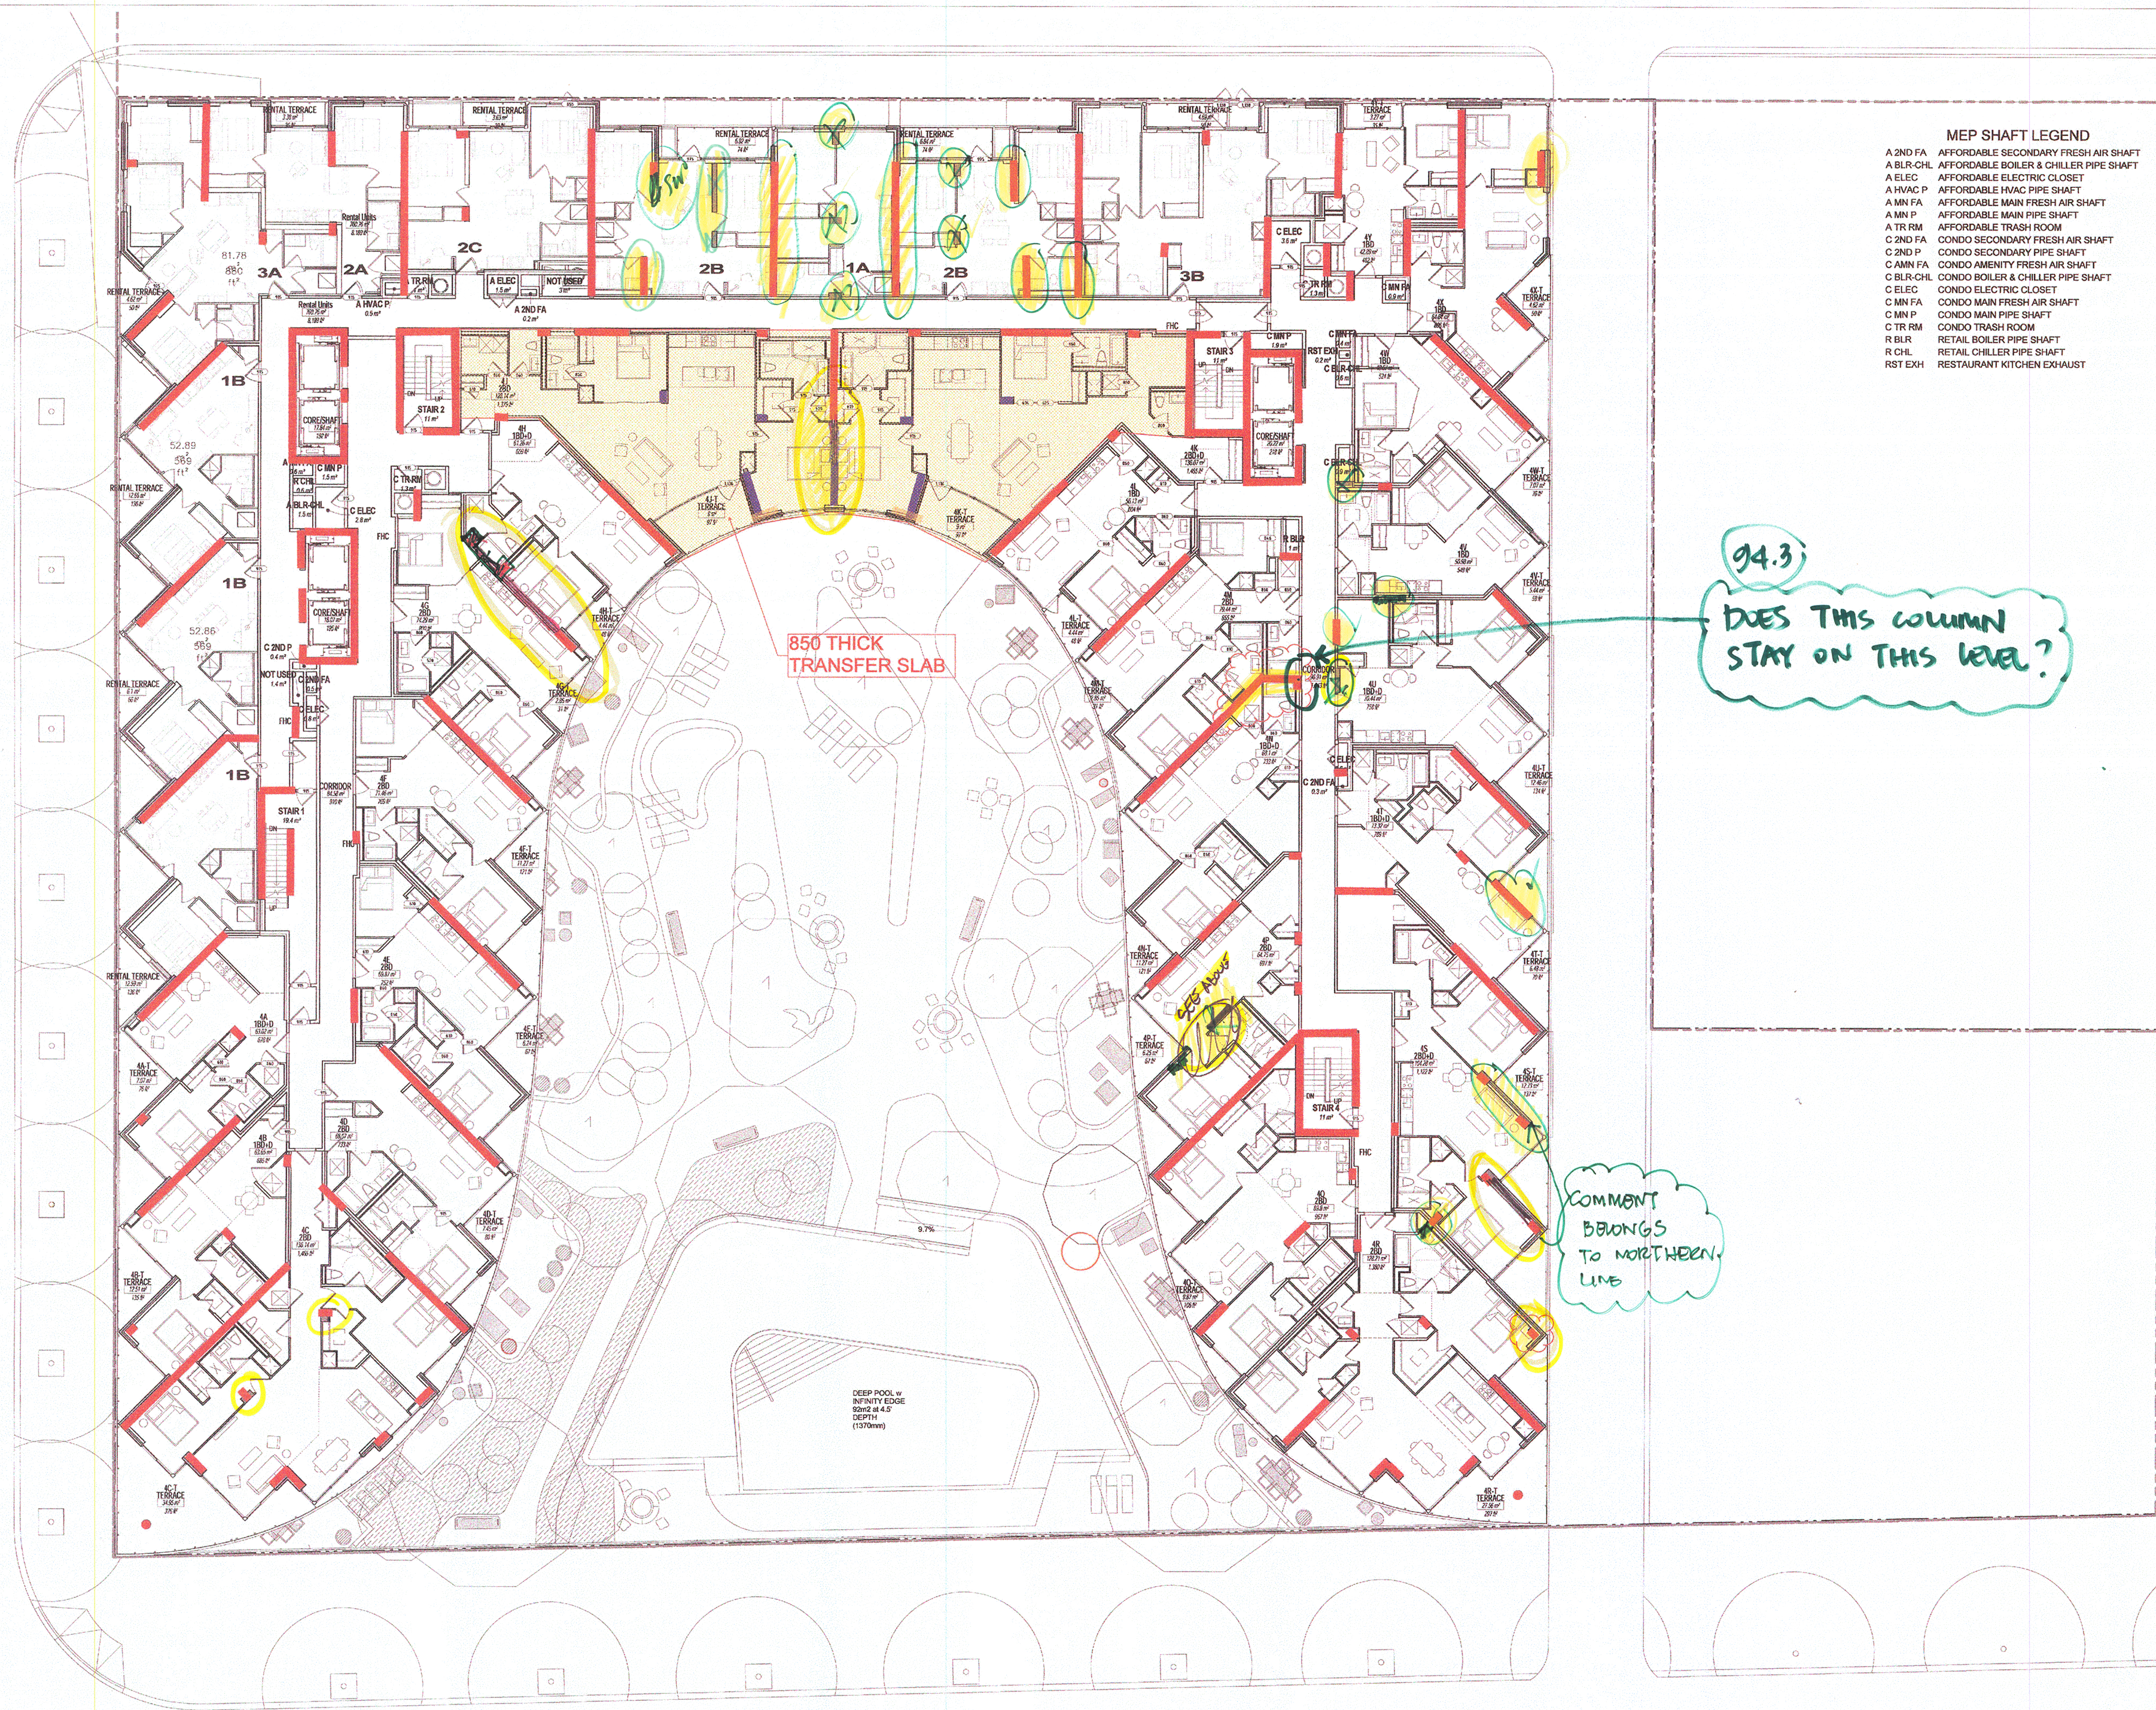

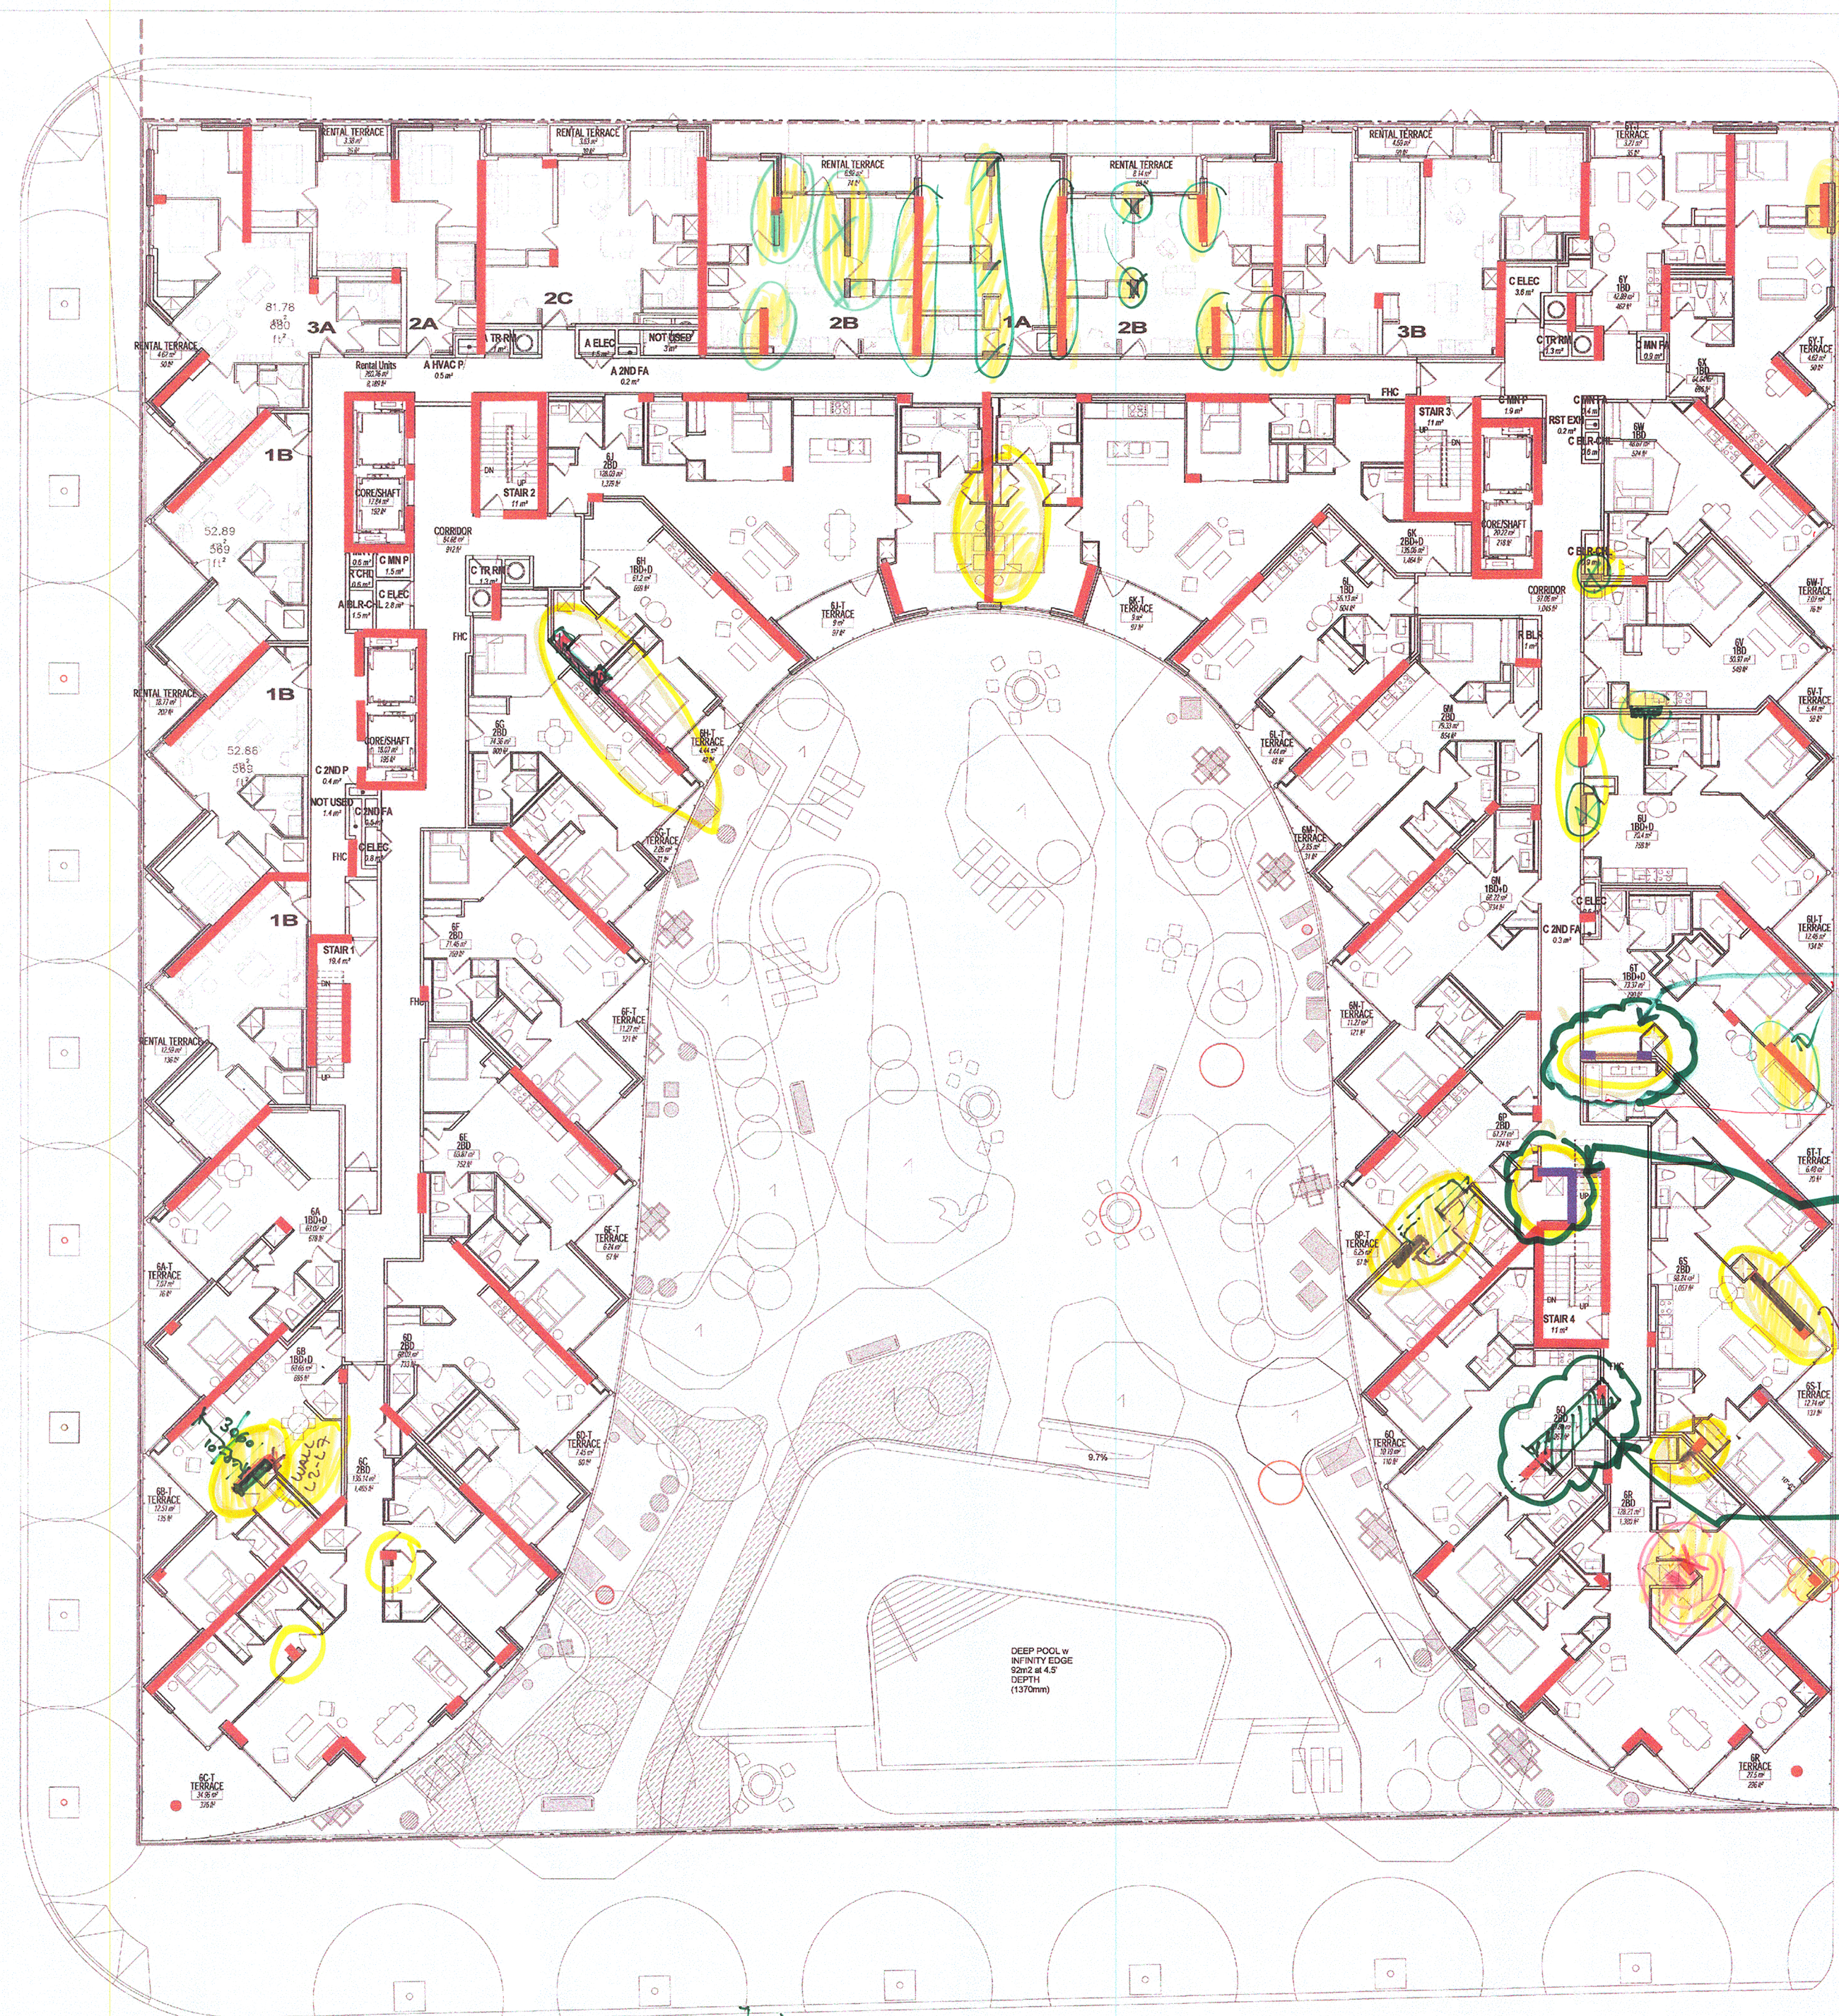

MEP SHAFT LEGEND

A 2ND FA	AFFORDABLE SECONDARY FRESH AIR SHAFT
A BLR-CHL	AFFORDABLE BOILER & CHILLER PIPE SHAFT
A ELEC	AFFORDABLE ELECTRIC CLOSET
A HVAC P	AFFORDABLE HVAC PIPE SHAFT
A MN FA	AFFORDABLE MAIN FRESH AIR SHAFT
A MN P	AFFORDABLE MAIN PIPE SHAFT
A TR RM	AFFORDABLE TRASH ROOM
C 2ND FA	CONDO SECONDARY FRESH AIR SHAFT
C 2ND P	CONDO SECONDARY PIPE SHAFT
C AMN FA	CONDO AMENITY FRESH AIR SHAFT
C BLR-CHL	CONDO BOILER & CHILLER PIPE SHAFT
C ELEC	CONDO ELECTRIC CLOSET
C MN FA	CONDO MAIN FRESH AIR SHAFT
C MN P	CONDO MAIN PIPE SHAFT
C TR RM	CONDO TRASH ROOM
R BLR	RETAIL BOILER PIPE SHAFT
R CHL	RETAIL CHILLER PIPE SHAFT
RST EXH	RESTAURANT KITCHEN EXHAUST

94.9
WHY HAS THIS AREA BEEN BUBBLED? CLARIFY.

94.10
WHY MARKED AS SHEAR WALL? NOT SUPPORTED FROM BELOW.

94.11
IS THERE TRANSFER SLAB IN L7 SLAB? PLEASE CONFIRM

Connect Column w.

Hand-drawn sketch of a structural column with dimensions: 3060, 215, 3275.

Hand-drawn sketch of a structural column with dimensions: 3060, 215, 3275.

MEP SHAFT LEGEND

A 2ND FA	AFFORDABLE SECONDARY FRESH AIR SHAFT
A BLR-CHL	AFFORDABLE BOILER & CHILLER PIPE SHAFT
A ELEC	AFFORDABLE ELECTRIC CLOSET
A HVAC P	AFFORDABLE HVAC PIPE SHAFT
A MN FA	AFFORDABLE MAIN FRESH AIR SHAFT
A MN P	AFFORDABLE MAIN PIPE SHAFT
A TR RM	AFFORDABLE TRASH ROOM
C 2ND FA	CONDO SECONDARY FRESH AIR SHAFT
C 2ND P	CONDO SECONDARY PIPE SHAFT
C AMN FA	CONDO AMENITY FRESH AIR SHAFT
C BLR-CHL	CONDO BOILER & CHILLER PIPE SHAFT
C ELEC	CONDO ELECTRIC CLOSET
C MN FA	CONDO MAIN FRESH AIR SHAFT
C MN P	CONDO MAIN PIPE SHAFT
C TR RM	CONDO TRASH ROOM
R BLR	RETAIL BOILER PIPE SHAFT
R CHL	RETAIL CHILLER PIPE SHAFT
RST EXH	RESTAURANT KITCHEN EXHAUST

450
TRANSFER SLAB

34.8
PORTION OF SHEAR WALL NOT SUPPORTED FROM BELOW. IS THERE TRANSFER SLAB IN SHADED AREA?

TRANSFER WALL
EXTEND WALL

DELETE

EXTEND

REMOVE

delete transfer slab

keep wall below & above aligned
NO TRANSFER SLAB REQUIRED

NO TRANSFER SLAB

L8
L7
delete Transfer slab

wall below
column erorp.

delete Transfer

94.1 SHEAR W. SHOULD BE DETECTED. CONFIRM

No Transfer see levels below

ADD WALL LEVEL 2-10

Extend WALL

- MEP SHAFT LEGEND
- A 2ND FA AFFORDABLE SECONDARY FRESH AIR SHAFT
 - A BLR-CHL AFFORDABLE BOILER & CHILLER PIPE SHAFT
 - A ELEC AFFORDABLE ELECTRIC CLOSET
 - A HVAC P AFFORDABLE HVAC PIPE SHAFT
 - A MN FA AFFORDABLE MAIN FRESH AIR SHAFT
 - A MN P AFFORDABLE MAIN PIPE SHAFT
 - A TR RM AFFORDABLE TRASH ROOM
 - C 2ND FA CONDO SECONDARY FRESH AIR SHAFT
 - C 2ND P CONDO SECONDARY PIPE SHAFT
 - C AMN FA CONDO AMENITY FRESH AIR SHAFT
 - C BLR-CHL CONDO BOILER & CHILLER PIPE SHAFT
 - C ELEC CONDO ELECTRIC CLOSET
 - C MN FA CONDO MAIN FRESH AIR SHAFT
 - C MN P CONDO MAIN PIPE SHAFT
 - C TELCM CONDO TELECOM
 - C TR RM CONDO TRASH ROOM
 - R BLR RETAIL BOILER PIPE SHAFT
 - R CHL RETAIL CHILLER PIPE SHAFT
 - RST EXH RESTAURANT KITCHEN EXHAUST

TRANSFER SLAB

94.1 CAN WE KEEP COLUMN INSTEAD OF SHEAR WALL? LIVING RM WIDTH GETS TOO NARROW.

MEP SHAFT LEGEND

A 2ND FA	AFFORDABLE SECONDARY FRESH AIR SHAFT
A BLR-CHL	AFFORDABLE BOILER & CHILLER PIPE SHAFT
A ELEC	AFFORDABLE ELECTRIC CLOSET
A HVAC P	AFFORDABLE HVAC PIPE SHAFT
A MN FA	AFFORDABLE MAIN FRESH AIR SHAFT
A MN P	AFFORDABLE MAIN PIPE SHAFT
A TR RM	AFFORDABLE TRASH ROOM
C 2ND FA	CONDO SECONDARY FRESH AIR SHAFT
C 2ND P	CONDO SECONDARY PIPE SHAFT
C AMN FA	CONDO AMENITY FRESH AIR SHAFT
C BLR-CHL	CONDO BOILER & CHILLER PIPE SHAFT
C ELEC	CONDO ELECTRIC CLOSET
C MN FA	CONDO MAIN FRESH AIR SHAFT
C MN P	CONDO MAIN PIPE SHAFT
C TELCM	CONDO TELECOM
C TR RM	CONDO TRASH ROOM
R BLR	RETAIL BOILER PIPE SHAFT
R CHL	RETAIL CHILLER PIPE SHAFT
RST EXH	RESTAURANT KITCHEN EXHAUST

TRANSFER SLAB

94.1 THIS PORTION OF SHEAR WALL NOT SUPPORTED FROM BELOW. TRIM IT OR DO TRANSFER SLAB IN L11 SLAB?

94.12 PLEASE CONFIRM TRANSFER SLAB IN SHADDED AREA IN L11 SLAB.


half below
half above

structural to review column layout

move envelope so that wall above is supported by column below


TRANS. SLAB IN L11


ADD WALL

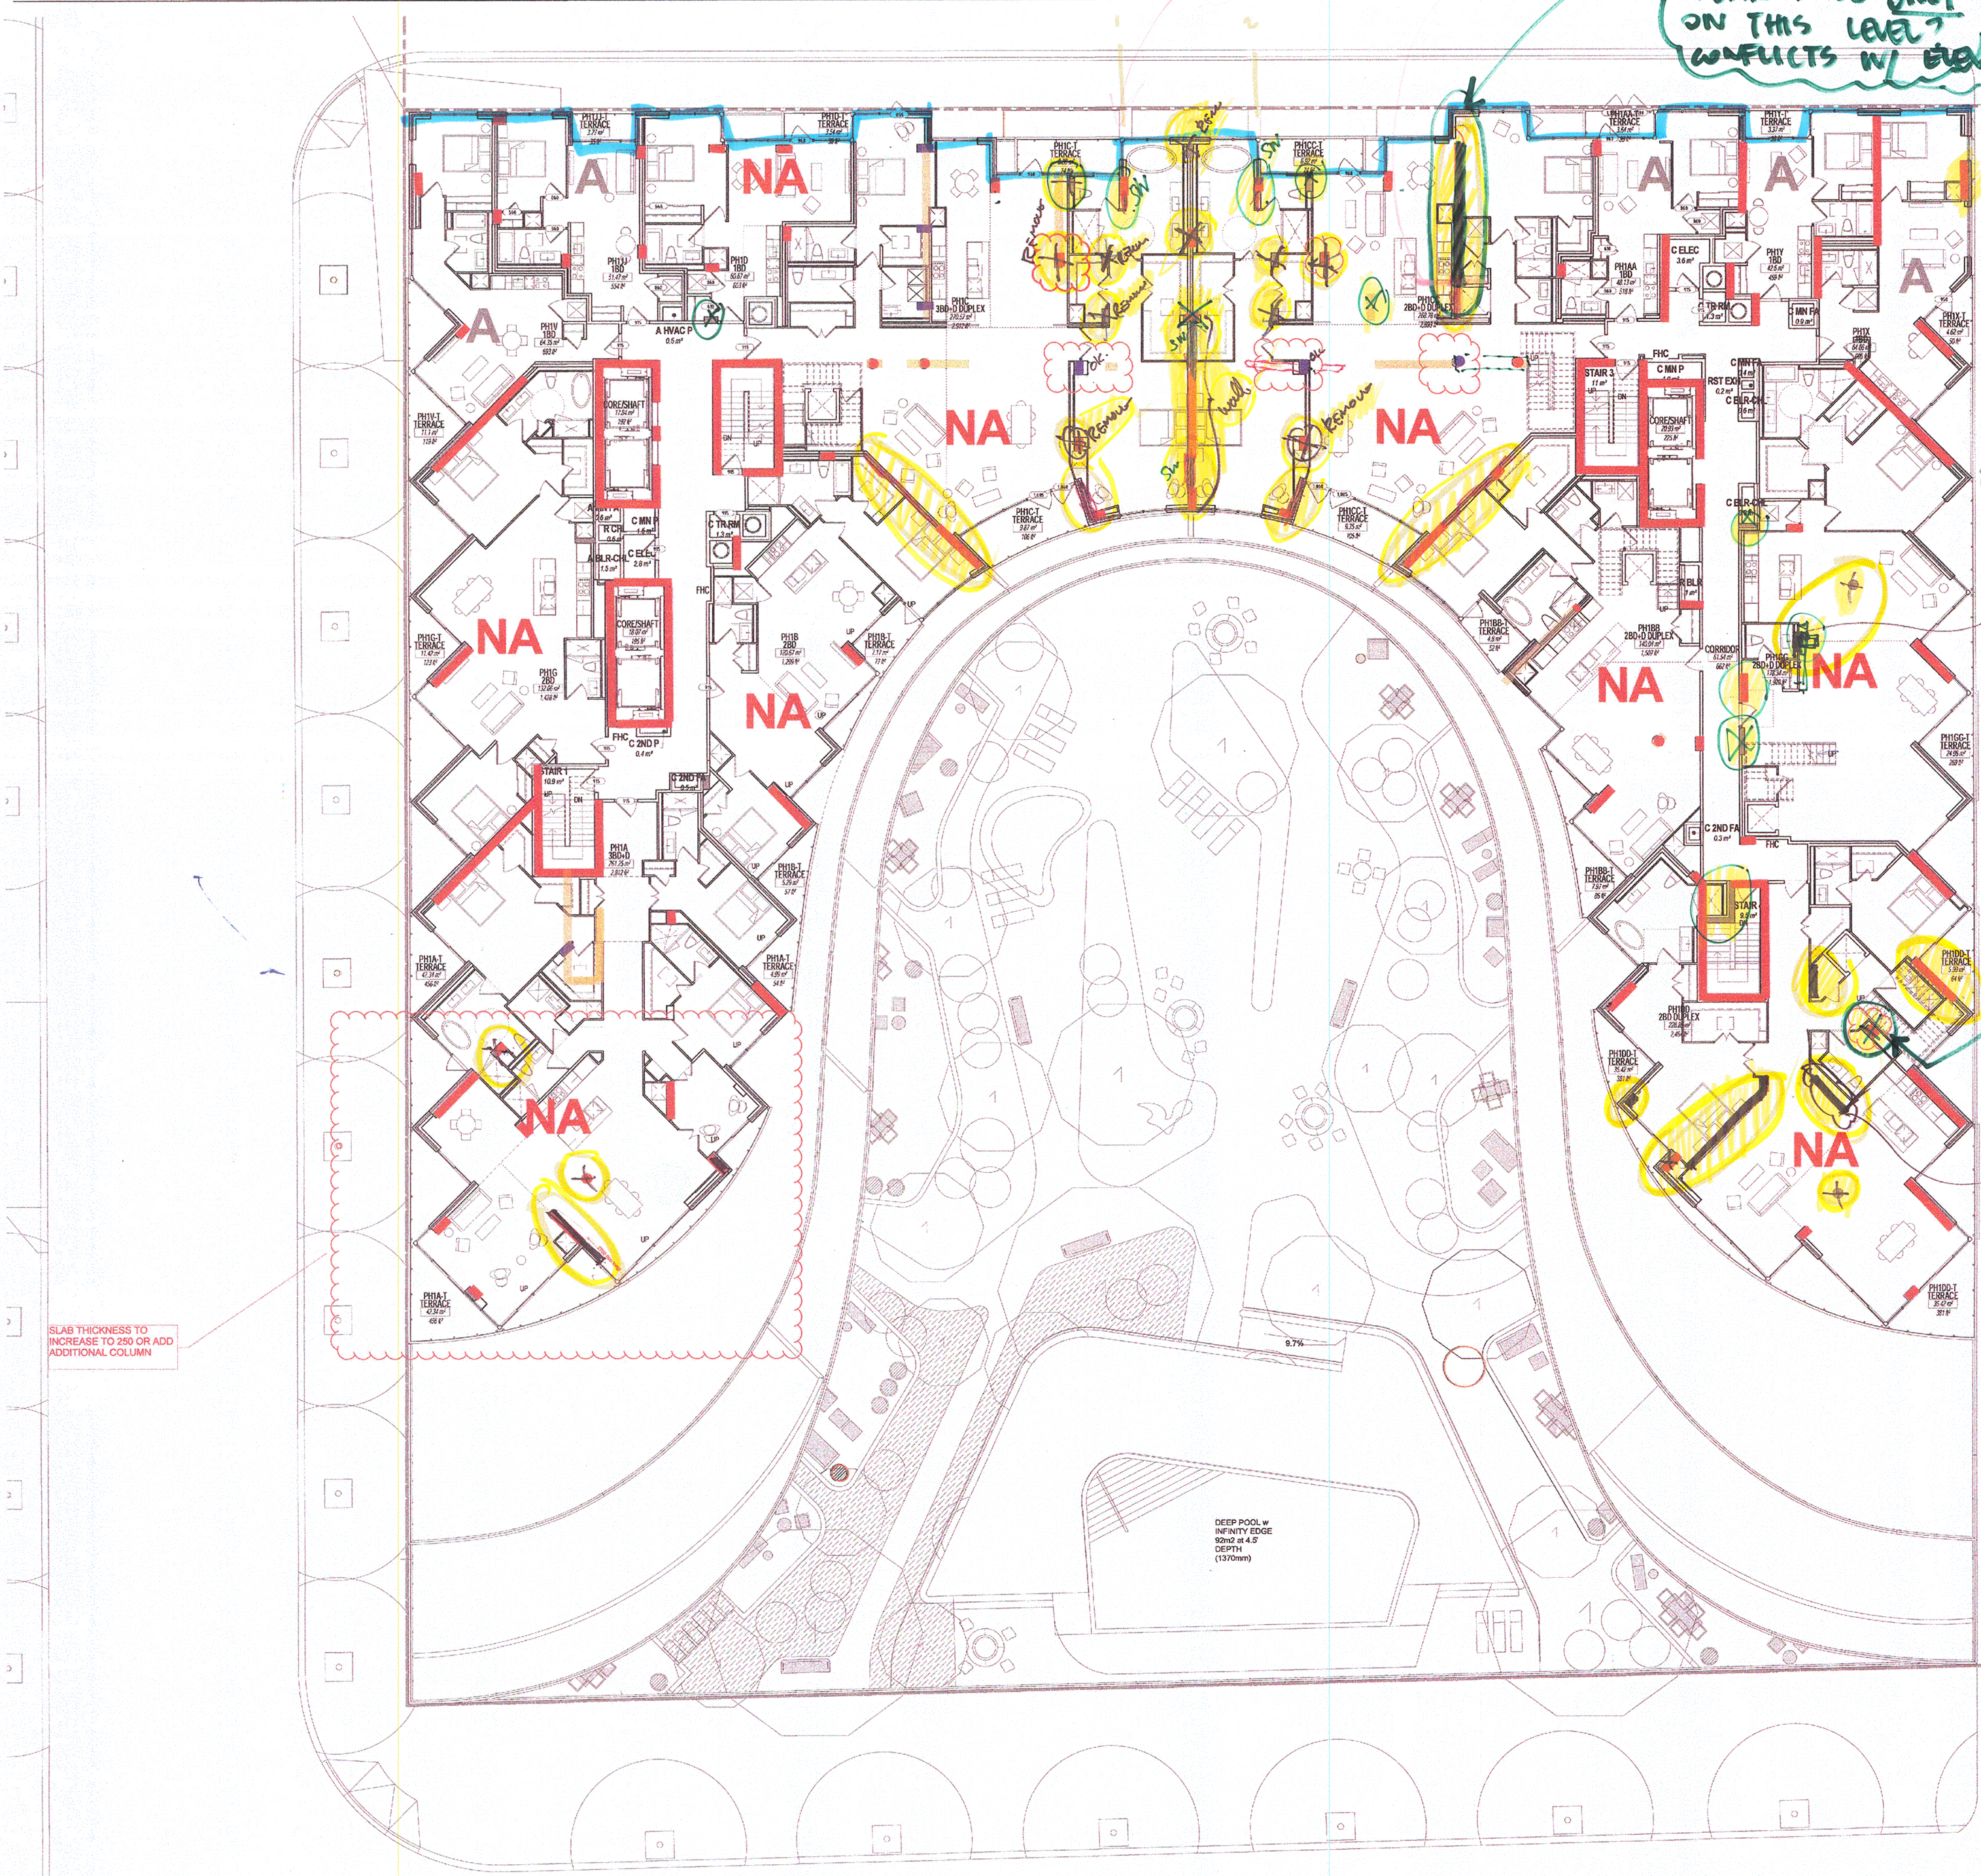

MEP SHAFT LEGEND

A 2ND FA	AFFORDABLE SECONDARY FRESH AIR SHAFT
A BLR-CHL	AFFORDABLE BOILER & CHILLER PIPE SHAFT
A ELEC	AFFORDABLE ELECTRIC CLOSET
A HVAC P	AFFORDABLE HVAC PIPE SHAFT
A MN FA	AFFORDABLE MAIN FRESH AIR SHAFT
A MN P	AFFORDABLE MAIN PIPE SHAFT
A TR RM	AFFORDABLE TRASH ROOM
C 2ND FA	CONDO SECONDARY FRESH AIR SHAFT
C 2ND P	CONDO SECONDARY PIPE SHAFT
C AMN FA	CONDO AMENITY FRESH AIR SHAFT
C BLR-CHL	CONDO BOILER & CHILLER PIPE SHAFT
C ELEC	CONDO ELECTRIC CLOSET
C MN FA	CONDO MAIN FRESH AIR SHAFT
C MN P	CONDO MAIN PIPE SHAFT
C TELCM	CONDO TELECOM
C TR RM	CONDO TRASH ROOM
R BLR	RETAIL BOILER PIPE SHAFT
R CHL	RETAIL CHILLER PIPE SHAFT
RST EXH	RESTAURANT KITCHEN EXHAUST

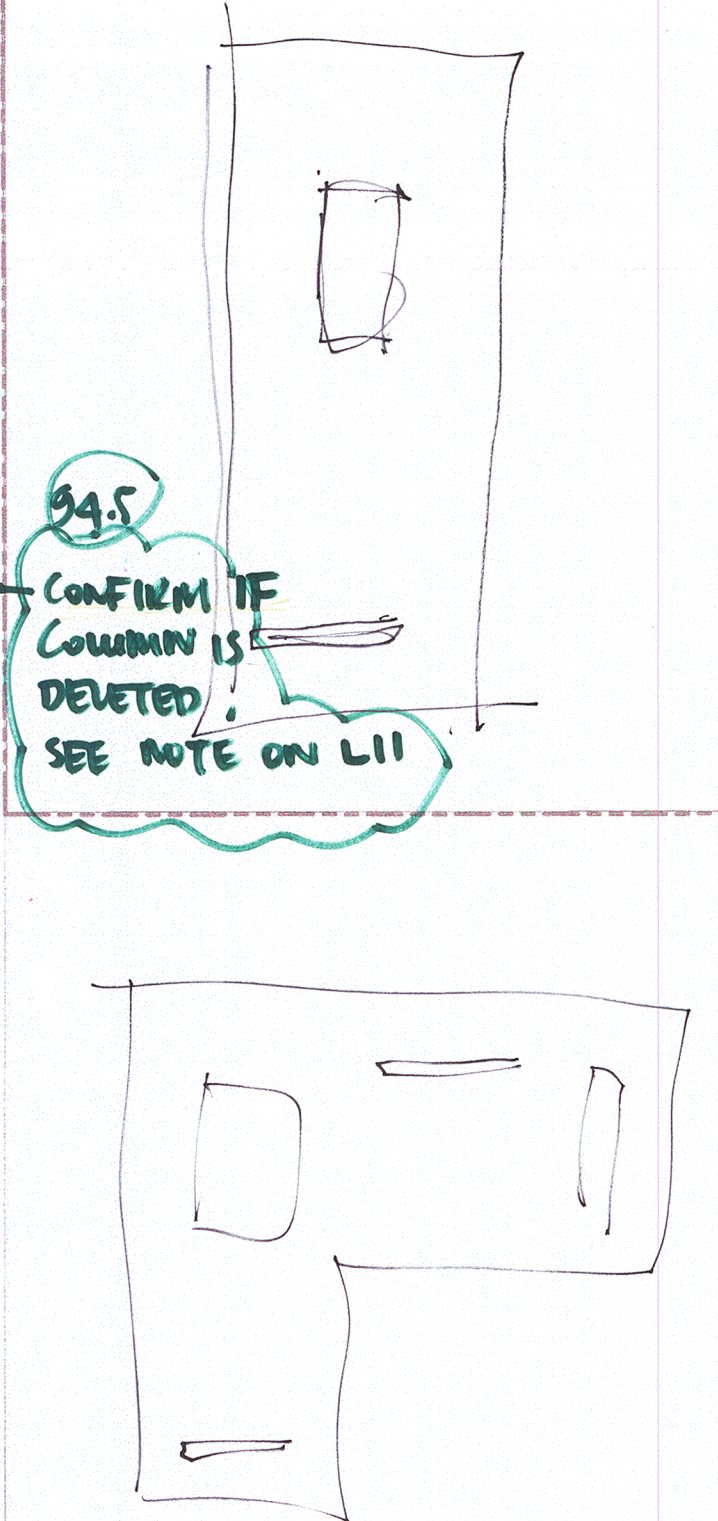

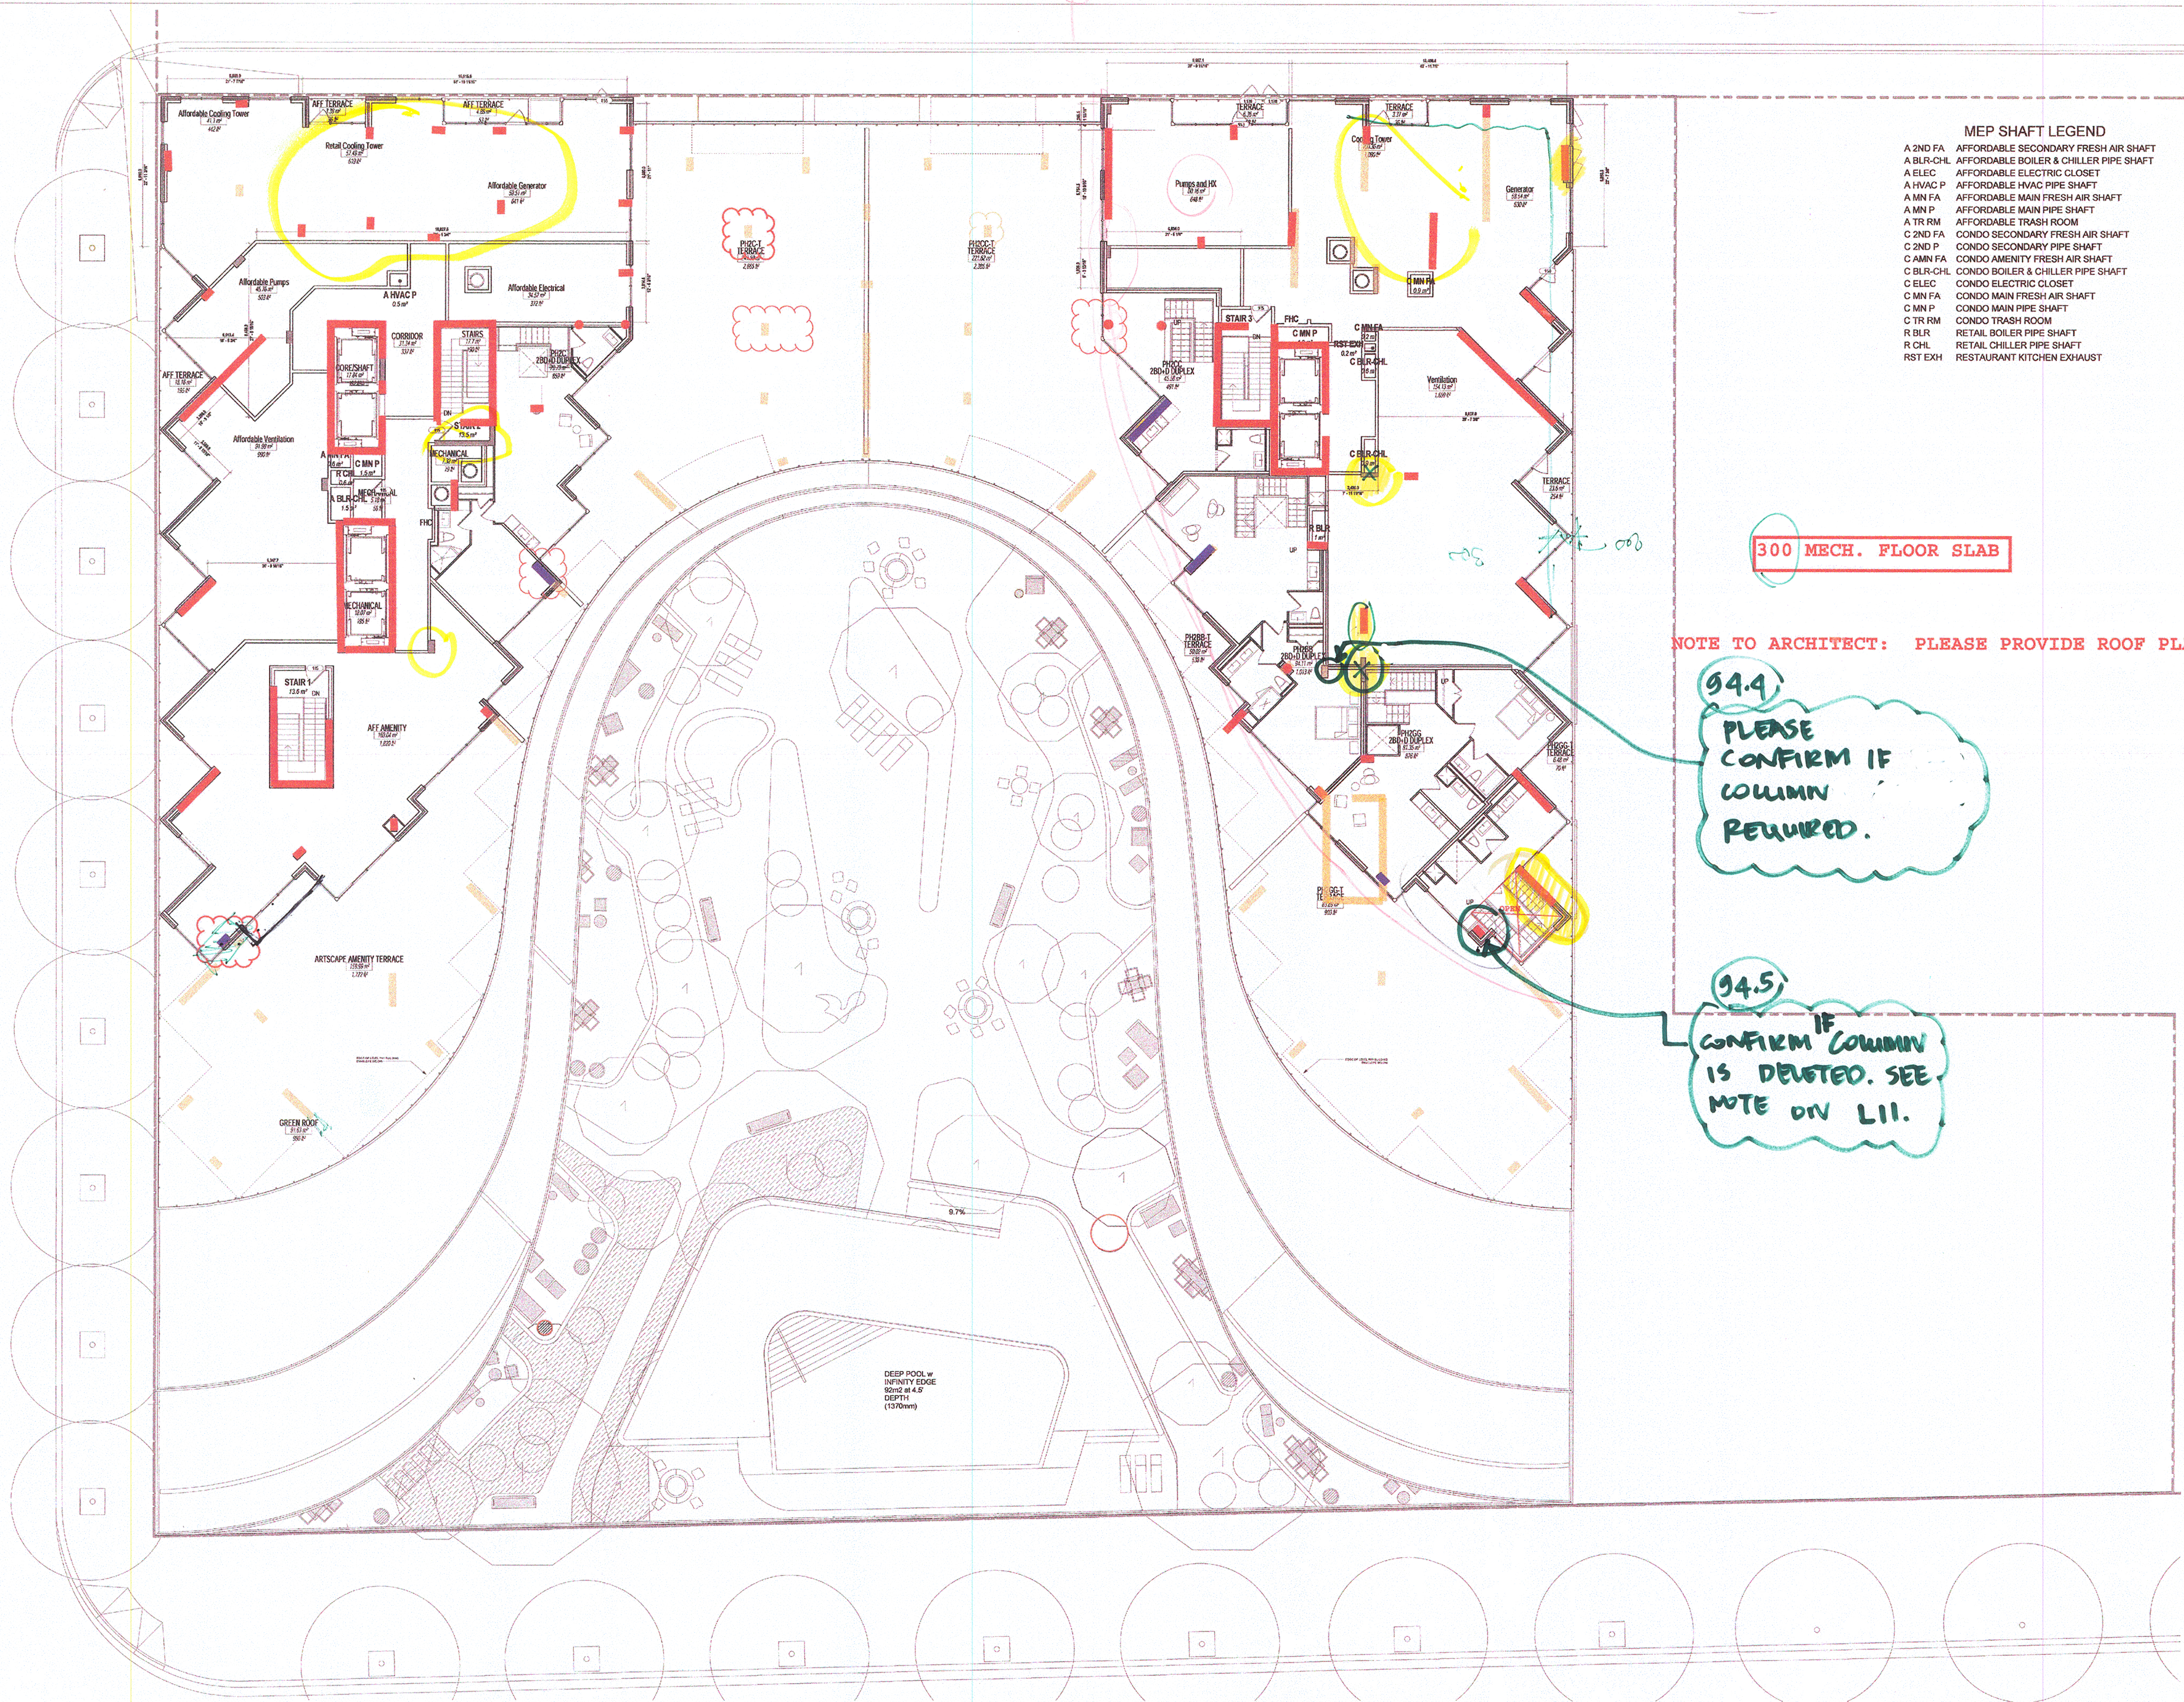

- MEP SHAFT LEGEND
- A 2ND FA AFFORDABLE SECONDARY FRESH AIR SHAFT
 - A BLR-CHL AFFORDABLE BOILER & CHILLER PIPE SHAFT
 - A ELEC AFFORDABLE ELECTRIC CLOSET
 - A HVAC AFFORDABLE HVAC PIPE SHAFT
 - A MN FA AFFORDABLE MAIN FRESH AIR SHAFT
 - A MN P AFFORDABLE MAIN PIPE SHAFT
 - A TR RM AFFORDABLE TRASH ROOM
 - C 2ND FA CONDO SECONDARY FRESH AIR SHAFT
 - C 2ND P CONDO SECONDARY PIPE SHAFT
 - C AMN FA CONDO AMENITY FRESH AIR SHAFT
 - C BLR-CHL CONDO BOILER & CHILLER PIPE SHAFT
 - C ELEC CONDO ELECTRIC CLOSET
 - C MN FA CONDO MAIN FRESH AIR SHAFT
 - C MN P CONDO MAIN PIPE SHAFT
 - C TR RM CONDO TRASH ROOM
 - R BLR RETAIL BOILER PIPE SHAFT
 - R CHL RETAIL CHILLER PIPE SHAFT
 - RST EXH RESTAURANT KITCHEN EXHAUST

300 MECH. FLOOR SLAB

NOTE TO ARCHITECT: PLEASE PROVIDE ROOF PLAN

94.4
PLEASE
CONFIRM IF
COLUMN
REQUIRED.

94.5
CONFIRM IF
COLUMN
IS DELETED. SEE
NOTE ON L11.